



PRODUCT PACK

CFS-IS: Firestop intumescent sealant

ETA – 10/0406

[TECHNICAL DATA](#) ➔


[APPLICATIONS](#) ➔

[CHANGE LOG](#) ➔



FIRESTOP INTUMESCENT SEALANT CFS-IS

A water-based acrylic intumescent firestop sealant for small to medium-sized cable and conduit penetration.

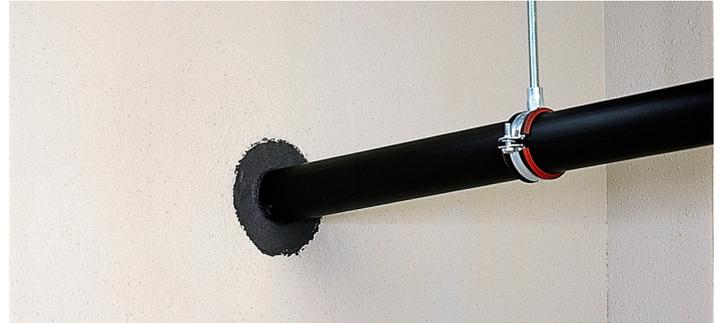

APPLICATIONS

- Fire seal for single cables and bundles
- Sealing of conduits
- Sealing of blank openings
- Sealing of irregular openings

ADVANTAGES

- Solvent free sealant, easy to clean up
- Simple adding of cables later on
- Low shrinkage of sealant
- Paintable with most paints
- Impermeable to air, N₂, CO₂ and CH₄

The European Technical Approval (ETA) and the technical data sheet can be obtained via your local Hilti contact.




Technical data

Chemical basis	Water-based acrylic sealant
Volume shrinkage	10-20 %
Intumescent	Yes
Cure Time (at 23°C/50% r.H)	~ 3 mm / 72 h
Application temperature range	5°C - 40°C
Storage and transportation temperature - range	5 °C - 25 °C
Shelf life (@73°F/23°C and 50% relative humidity)	12 month(s)
Reaction to fire classification according to EN 13501-1	Class E
Approvals	ETA-10 / 0406

Packaging	Volume	Colour	Order designation	Sales quantity	Item number
Cartridge	310 ml	Anthracite	Firestop intumescent sealant CFS-IS	1 pc	02025238
Cartridge	310 ml	Anthracite	Firestop intumescent sealant CFS-IS	1 pc	02004613
Cartridge	310 ml	Anthracite	Firestop intumescent sealant CFS-IS	1 pc	02004614
Cartridge	310 ml	Anthracite	Firestop intumescent sealant CFS-IS	1 pc	02004615


INSTALLATION INSTRUCTIONS

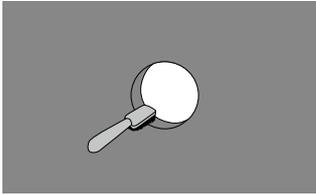

Clean the opening to be sealed. The material around the opening must be dry, in sound condition and free from dust or grease.




Pack mineral wool. Leave sufficient depth for applying CFS-IS.

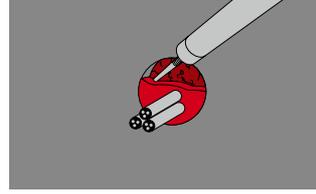

Apply CFS-IS. Apply to the required depth in order to obtain the desired fire rating. Making sure CFS-IS contacts all surfaces to provide maximum adhesion.



Smooth CFS-IS. Smooth before the skin forms using water and a spatula. Leave completed seal undisturbed for 48 hours.

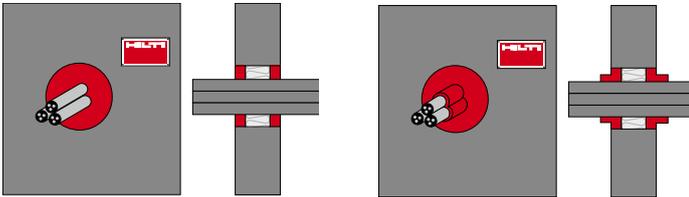

For maintenance reasons, a penetration seal could be permanently marked with an installation plate. For special seal types with additional sealant CFS-IS along the cables/conduits see ETA-10/0406 and/or specific standard detail within this pack for more information.

Loose mineral wool products suitable for being used as backfilling material of Hilti Firestop Intumescent Sealant CFS-IS: Heralan LS (Knauf Insulation), Isover loose wool SL (Saint-Gobain Isover), Isover Universal-Stopfwole (Saint-Gobain Isover), Rockwool RL (Rockwool), Paroc Pro Loose Wool (Paroc OY AB).

Note: Application in single skin walls require backing with Rockwool RWA-45.

ADDITIONAL ATTRIBUTES

Characteristics	Assessment of characteristics	Norm, standard, test
Health and the environment Air permeability (gas tightness)	Impermeable for air, Nitrogen (N ₂), CO ₂ and Methane (CH ₄) determined for 50 mm thickness of CFS-IS	EN 1026
Dangerous substances	CFS-IS is in compliance concerning the registration, evaluation, authorization and restriction of Chemicals (REACH). The product specification has been compared with the list of dangerous substances of the European Commission to verify that it does not contain such substances above the acceptable limits.	Material safety data sheet
Durability and serviceability	Use category Y ₂ , (-5/+70)° C (suitable for penetration seals intended for use at temperatures between -5° C and +70° C, no exposure to rain or UV).	ETAG 026-2
Electrical properties	Volume resistivity 164 x 10 ¹⁰ ± 55 x 10 ¹⁰ Ohm Surface resistivity 318 x 10 ⁶ ± 84 x 10 ⁶ Ohm	DIN IEC 60093 (VDE 0303 Part 30)
Reaction to fire	Class E	EN 13501-1

◀ Back

APPLICATION INFORMATION

FOR PIPES/CABLE DIAMETERS

S = Single pipe/cable*

B = pipe/cable Bundle

*For pipes, if no S or B, assume single pipe.

FOR INSULATION

N-C = Non-Combustible (e.g., stone wool etc.)

C = Combustible (e.g., Armaflex, phenolic etc.)

None = No insulation

LS = Local Sustained

LI = Local Interrupted

CS = Continuous Sustained

CI = Continuous Interrupted

Please note, in many cases details have numerous pages. Please check all pages for the necessary information as differing insulation layouts might be on differing pages (e.g., LS one page 1 and LI on page 2 etc.).

PENETRATION TYPE

Single = penetration seal intended for penetrations with only one service passing through

Multi = penetration seal intended for penetrations where more than one service of the same type (e.g. cables) or pipe material group pass through

Mixed = penetration seal intended for penetrations where more than one type of services (e.g. cables and pipes or pipes of different pipe material groups) pass through


CLASSIFICATION

Classification will give the best-case EI value possible. As such, check each specific detail as there may be instances where a higher I value is possible or another sized service within the application may attain a lower value (e.g., 110mm pipe achieves EI 120 but a 160mm pipe achieves EI 90).


PRODUCT/DETAIL

Full product name first/Detail ID (See specific detail for the full ID).


Please note, in many cases details have numerous pages. Please check all pages for the necessary information.




Continued Interrupted (CI)




Continued Sustained (CS)




Continued Interrupted (CI)




Continued Sustained (CS)




Local Interrupted (LI)



Local Sustained (LS)



Local Interrupted (LI)



Local Sustained (LS)

Single board drywall	Double board drywall	Rigid wall	Timber wall	Sandwich panel	Rigid floor	Timber floor	Metal deck	Linear joints				
Mechanical			Electrical			HVAC						
Min. base material thickness	Material	Pipes ¹		N/C	Insulation ¹		Penetration type ¹			Classification ¹	Product/Detail ¹	
		Size			C	None	Single	Multi	Mixed			
≥ 100	PE-XD	Ø ≥ 16 - 50			LS			✓			EI 120	CFS-IS:FW/RW-M-01
≥ 100	PE-XB	Ø ≥ 16 - 50			LS			✓			EI 120	CFS-IS:FW/RW-M-01
≥ 100	PE-HD	Ø ≥ 16 - 50			LS			✓			EI 120	CFS-IS:FW/RW-M-01
≥ 100	PE-AI	Ø ≥ 16 - 50			LS			✓			EI 120	CFS-IS:FW/RW-M-01
≥ 100	PE-RT	Ø ≥ 16 - 40			LS			✓			EI 120	CFS-IS:FW/RW-M-01
≥ 100	PE-XD	Ø ≥ 16 - 50					✓	✓			EI 120	CFS-IS:FW/RW-M-02
≥ 100	PE-XB	Ø ≥ 16 - 50					✓	✓			EI 120	CFS-IS:FW/RW-M-02
≥ 100	PE-HD	Ø ≥ 16 - 50					✓	✓			EI 120	CFS-IS:FW/RW-M-02
≥ 100	PE-AI	Ø ≥ 16 - 50					✓	✓			EI 120	CFS-IS:FW/RW-M-02
≥ 100	PE-RT	Ø ≥ 16 - 40					✓	✓			EI 120	CFS-IS:FW/RW-M-02
≥ 100	PP	Ø ≥ 32 - 50					✓	✓			EI 120	CFS-IS:FW/RW-M-02
≥ 100	PVC	Ø ≥ 16 - 50					✓	✓			EI 120	CFS-IS:FW/RW-M-03
≥ 110	Copper	Ø ≥ 10 - 89		LS				✓			EI 120	CFS-IS:FW/RW-M-04
≥ 110	Steel	Ø ≥ 10 - 89		LS				✓			EI 120	CFS-IS:FW/RW-M-04
≥ 110	Copper	Ø ≥ 10 - 89			CS			✓			EI 120	CFS-IS:FW/RW-M-04
≥ 110	Steel	Ø ≥ 10 - 89			CS			✓			EI 120	CFS-IS:FW/RW-M-04



Single board drywall	Double board drywall	Rigid wall	Timber wall	Sandwich panel	Rigid floor	Timber floor	Metal deck	Linear joints				
Mechanical			Electrical			HVAC						
Min. base material thickness	Material	Pipes ¹		N/C	Insulation ¹		Penetration type ¹			Classification ¹	Product/Detail ¹	
		Size			C	None	Single	Multi	Mixed			
≥ 100	PE-XD	Ø ≥ 16 - 50			LS			✓			EI 120	CFS-IS:FW/RW-M-01
≥ 100	PE-XB	Ø ≥ 16 - 50			LS			✓			EI 120	CFS-IS:FW/RW-M-01
≥ 100	PE-HD	Ø ≥ 16 - 50			LS			✓			EI 120	CFS-IS:FW/RW-M-01
≥ 100	PE-AI	Ø ≥ 16 - 50			LS			✓			EI 120	CFS-IS:FW/RW-M-01
≥ 100	PE-RT	Ø ≥ 16 - 40			LS			✓			EI 120	CFS-IS:FW/RW-M-01
≥ 100	PE-XD	Ø ≥ 16 - 50					✓	✓			EI 120	CFS-IS:FW/RW-M-02
≥ 100	PE-XB	Ø ≥ 16 - 50					✓	✓			EI 120	CFS-IS:FW/RW-M-02
≥ 100	PE-HD	Ø ≥ 16 - 50					✓	✓			EI 120	CFS-IS:FW/RW-M-02
≥ 100	PE-AI	Ø ≥ 16 - 50					✓	✓			EI 120	CFS-IS:FW/RW-M-02
≥ 100	PE-RT	Ø ≥ 16 - 40					✓	✓			EI 120	CFS-IS:FW/RW-M-02
≥ 100	PP	Ø ≥ 32 - 50					✓	✓			EI 120	CFS-IS:FW/RW-M-02
≥ 100	PVC	Ø ≥ 16 - 50					✓	✓			EI 120	CFS-IS:FW/RW-M-03
≥ 110	Copper	Ø ≥ 10 - 89		LS				✓			EI 120	CFS-IS:FW/RW-M-04
≥ 110	Steel	Ø ≥ 10 - 89		LS				✓			EI 120	CFS-IS:FW/RW-M-04
≥ 110	Copper	Ø ≥ 10 - 89			CS			✓			EI 120	CFS-IS:FW/RW-M-04
≥ 110	Steel	Ø ≥ 10 - 89			CS			✓			EI 120	CFS-IS:FW/RW-M-04
≥ 150	PVC	Ø ≥ 32 - 50					✓	✓			EI 180	CFS-IS:RW-M-01



Single board drywall	Double board drywall	Rigid wall	Timber wall	Sandwich panel	Rigid floor	Timber floor	Metal deck	Linear joints			
Mechanical			Electrical			HVAC					
Min. base material thickness	Material	Pipes ¹		N/C	Insulation ¹		Penetration type ¹			Classification ¹	Product/Detail ¹
		Size			C	None	Single	Multi	Mixed		
≥ 150	PE-XD	Ø ≥ 16 - 50		LS			✓			EI 120	CFS-IS:RF-M-01
≥ 150	PE-XB	Ø ≥ 16 - 50		LS			✓			EI 120	CFS-IS:RF-M-01
≥ 150	PE-HD	Ø ≥ 16 - 50		LS			✓			EI 120	CFS-IS:RF-M-01
≥ 150	PE-AI	Ø ≥ 16 - 50		LS			✓			EI 120	CFS-IS:RF-M-01
≥ 150	PE-RT	Ø ≥ 16 - 40		LS			✓			EI 120	CFS-IS:RF-M-01
≥ 150	PE-XD	Ø ≥ 16 - 50			✓		✓			EI 120	CFS-IS:RF-M-02
≥ 150	PE-XB	Ø ≥ 16 - 50			✓		✓			EI 120	CFS-IS:RF-M-02
≥ 150	PE-HD	Ø ≥ 16 - 50			✓		✓			EI 120	CFS-IS:RF-M-02
≥ 150	PE-AI	Ø ≥ 16 - 50			✓		✓			EI 120	CFS-IS:RF-M-02
≥ 150	PE-RT	Ø ≥ 16 - 40			✓		✓			EI 120	CFS-IS:RF-M-02
≥ 150	PP	Ø ≥ 32 - 50			✓		✓			EI 120	CFS-IS:RF-M-02
≥ 150	PVC	Ø ≥ 16 - 50			✓		✓			EI 120	CFS-IS:RF-M-03
≥ 150	Copper	Ø ≥ 10 - 89	LS				✓			EI 120	CFS-IS:RF-M-04
≥ 150	Steel	Ø ≥ 10 - 89	LS				✓			EI 120	CFS-IS:RF-M-04
≥ 150	Copper	Ø ≥ 10 - 89		CS			✓			EI 120	CFS-IS:RF-M-04
≥ 150	Steel	Ø ≥ 10 - 89		CS			✓			EI 120	CFS-IS:RF-M-04



Single board drywall	Double board drywall	Rigid wall	Timber wall	Sandwich panel	Rigid floor	Timber floor	Metal deck	Linear joints		
Mechanical		Electrical				HVAC				
Min. base material thickness	Cables S = $\varnothing \leq 80$ B = $\varnothing \leq 100$	Tray	Electrical service			Penetration type ¹			Classification ¹	Product/Detail ¹
			Conduit	NC or C conduit	Trunking	Single	Multi	Mixed		
≥ 100						✓	✓		EI 120	CFS-IS:FW/RW-E-01
≥ 100			S = $\varnothing \leq 16-32$	C		✓	✓		EI 120	CFS-IS:FW/RW-E-02
≥ 100			S = $\varnothing \leq 16$	NC		✓	✓		EI 120	CFS-IS:FW/RW-E-02
≥ 110			S = $\varnothing \leq 80$	C		✓	✓		EI 120	CFS-IS:FW/RW-E-02



Single board drywall	Double board drywall	Rigid wall	Timber wall	Sandwich panel	Rigid floor	Timber floor	Metal deck	Linear joints		
Mechanical		Electrical				HVAC				
Min. base material thickness	Cables S = Ø ≤ 80 B = Ø ≤ 100	Tray	Electrical service			Penetration type ¹			Classification ¹	Product/Detail ¹
			Conduit	NC or C conduit	Trunking	Single	Multi	Mixed		
≥ 100						✓	✓		EI 120	CFS-IS:FW/RW-E-01
≥ 100			S = Ø ≤ 16-32	C		✓	✓		EI 120	CFS-IS:FW/RW-E-02
≥ 100			S = Ø ≤ 16	NC		✓	✓		EI 120	CFS-IS:FW/RW-E-02
≥ 110			S = Ø ≤ 80	C		✓	✓		EI 120	CFS-IS:FW/RW-E-02
≥ 150	S = Ø ≤ 80 B = Ø ≤ 100					✓	✓		EI 120	CFS-IS:RW-E-01
≥ 150	S = Ø ≤ 80					✓	✓		EI 180	CFS-IS:RW-E-01



Single board drywall	Double board drywall	Rigid wall	Timber wall	Sandwich panel	Rigid floor	Timber floor	Metal deck	Linear joints		
Mechanical		Electrical				HVAC				
Min. base material thickness	Cables S = Ø ≤ 80 B = Ø ≤ 100	Tray	Electrical service			Penetration type ¹			Classification ¹	Product/Detail ¹
			Conduit	NC or C conduit	Trunking	Single	Multi	Mixed		
≥ 150						✓	✓		EI 120	CFS-IS:RF-E-01
≥ 150			S = Ø ≤ 16	C&NC		✓	✓		EI 120	CFS-IS:RF-E-02
≥ 150			S = Ø ≤ 16-32	NC		✓	✓		EI 120	CFS-IS:RF-E-03



◀ Back

IS: SP-FW/RW-E-01


CABLES WITHIN FLEXIBLE & RIGID WALLS

Fire rating up to EI 120

Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG [▶](#) PDF [▶](#) Web [▶](#)

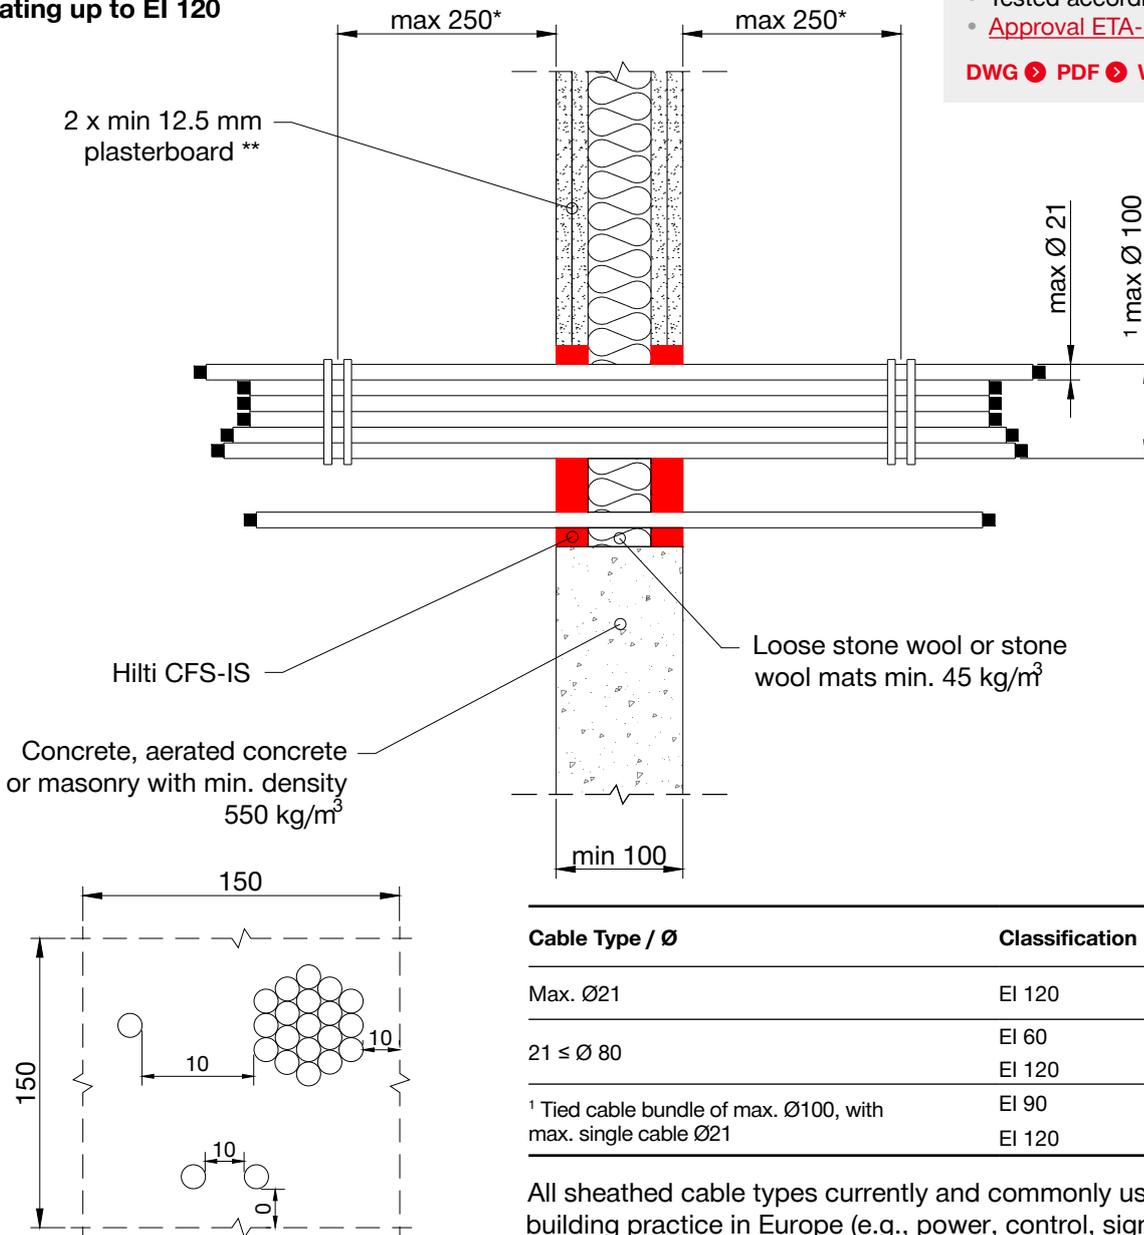

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm). Min. 100mm distance to other firestopping penetrations and timber studs. Min. 200mm to other penetrations (e.g., doors, windows etc.)

Cable Type / Ø	Classification
Max. Ø21	EI 120
21 ≤ Ø 80	EI 60
	EI 120
1 Tied cable bundle of max. Ø100, with max. single cable Ø21	EI 90
	EI 120

All sheathed cable types currently and commonly used in building practice in Europe (e.g., power, control, signal, telecommunication, data, optical fibre).

* First support and ancillary products should be capable of achieving the same fire performance as the seal and supporting structure.

** Comprising of timber or steel studs. Wall construction itself has been classified according to EN 13501-2.

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

◀ Back

IS: SP-FW/RW-E-01


CABLES WITHIN FLEXIBLE & RIGID WALLS

Fire rating up to EI 120

Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG [▶](#) PDF [▶](#) Web [▶](#)

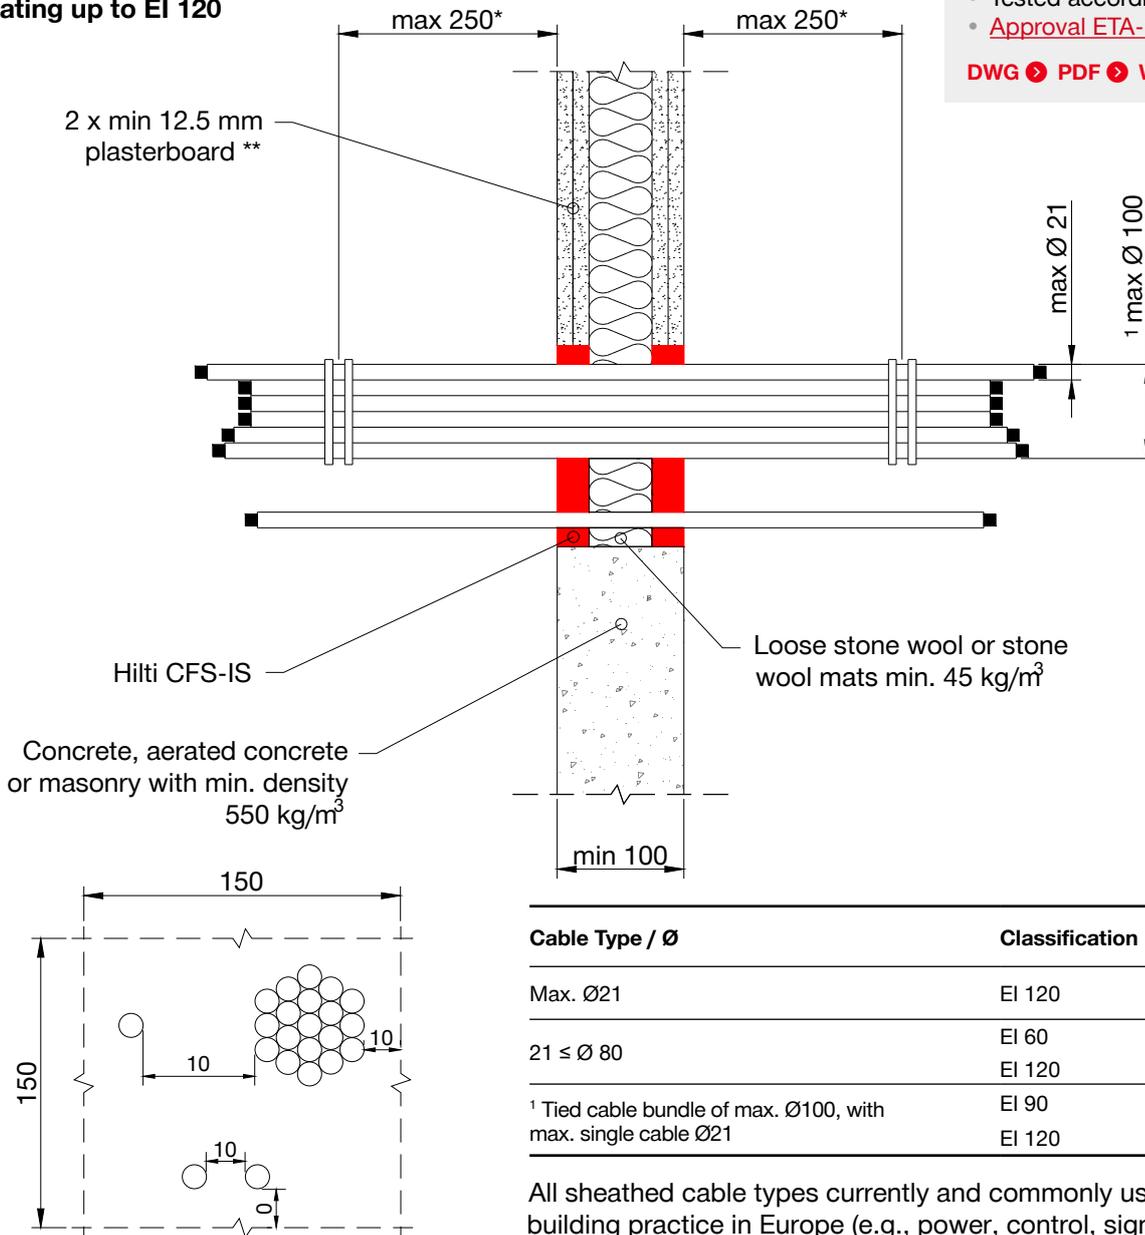

Cable Type / Ø	Classification
Max. Ø21	EI 120
21 ≤ Ø 80	EI 60
	EI 120
1 Tied cable bundle of max. Ø100, with max. single cable Ø21	EI 90
	EI 120

All sheathed cable types currently and commonly used in building practice in Europe (e.g., power, control, signal, telecommunication, data, optical fibre).

* First support and ancillary products should be capable of achieving the same fire performance as the seal and supporting structure.

** Comprising of timber or steel studs. Wall construction itself has been classified according to EN 13501-2.

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm). Min. 100mm distance to other firestopping penetrations and timber studs. Min. 200mm to other penetrations (e.g., doors, windows etc.)

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

IS: SP-FW/RW-E-02



MULTIPLE CONDUITS WITHIN FLEXIBLE AND RIGID WALLS

Fire rating up to EI 120

Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG PDF Web

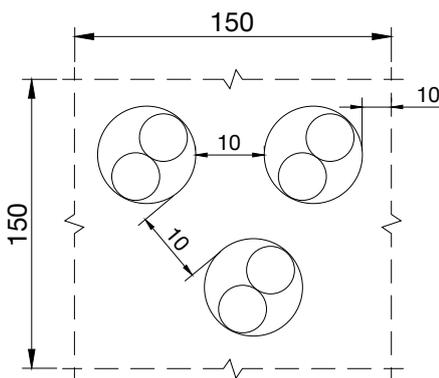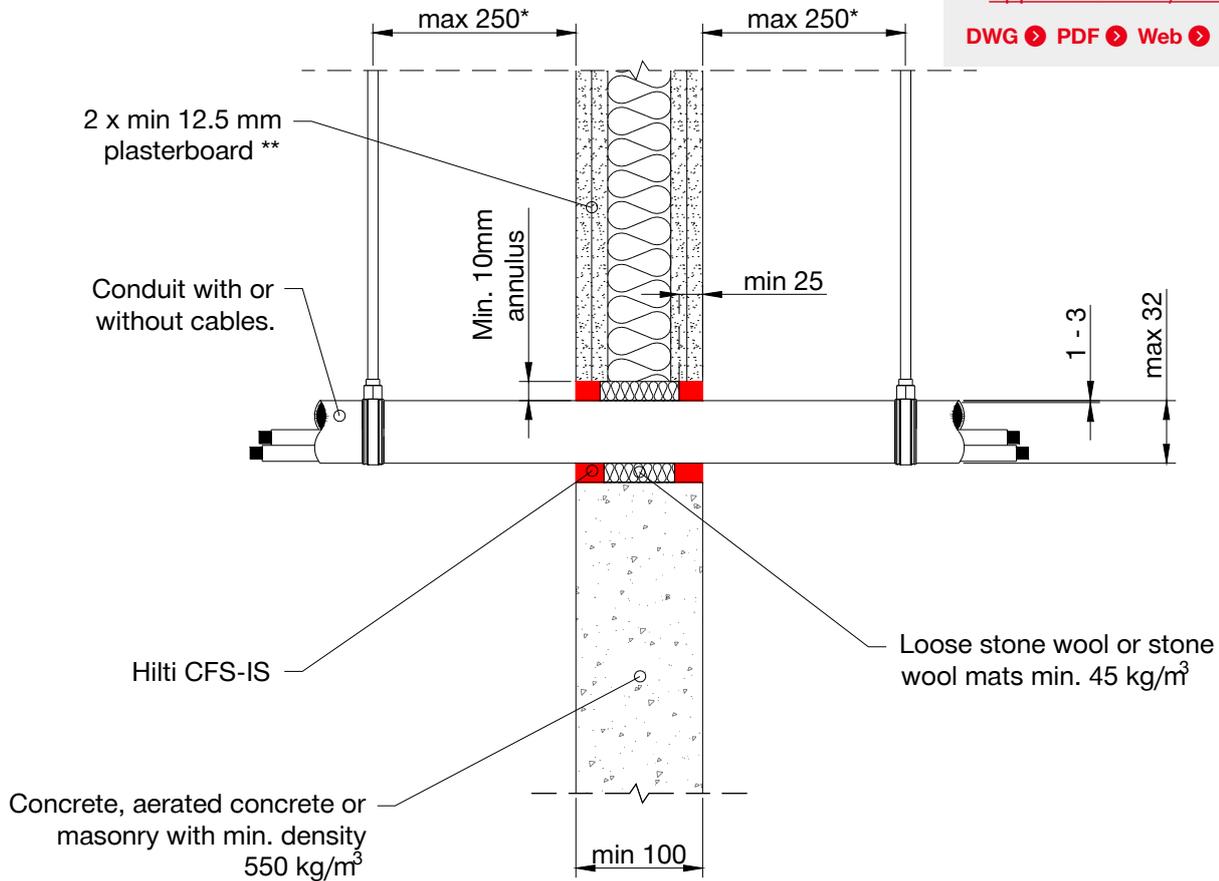

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm)
 Min. 100mm distance to other firestopping penetrations and timber studs. Min. 200mm to other penetrations (e.g., doors, windows etc.)

Multiple Conduits

Conduit Type / Ø	Classification
Small Steel ≤ Ø16, arranged linear	EI 120 C/U
Small Steel ≤ Ø16, arranged linear	EI 120-U/C
Plastic, diameter 16 ≤ Ø 16 ≤ 32, wall thickness 1-3, arranged linear or in cluster	EI 120-U/C

All sheathed cable types currently and commonly used in building practice in Europe (e.g., power, control, signal, telecommunication, data, optical fibre).

* First support and ancillary products should be capable of achieving the same fire performance as the seal and supporting structure.

** Comprising of timber or steel studs. Wall construction itself has been classified according to EN 13501-2.

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

IS: SP-FW/RW-E-02



MULTIPLE CONDUITS WITHIN FLEXIBLE AND RIGID WALLS

Fire rating up to EI 120

Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG PDF Web

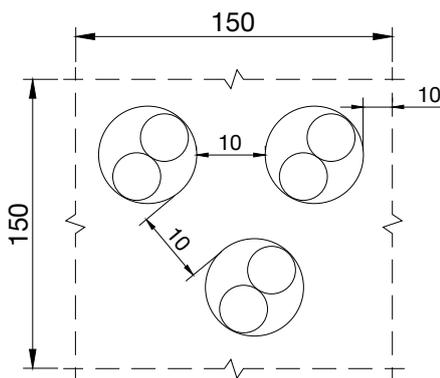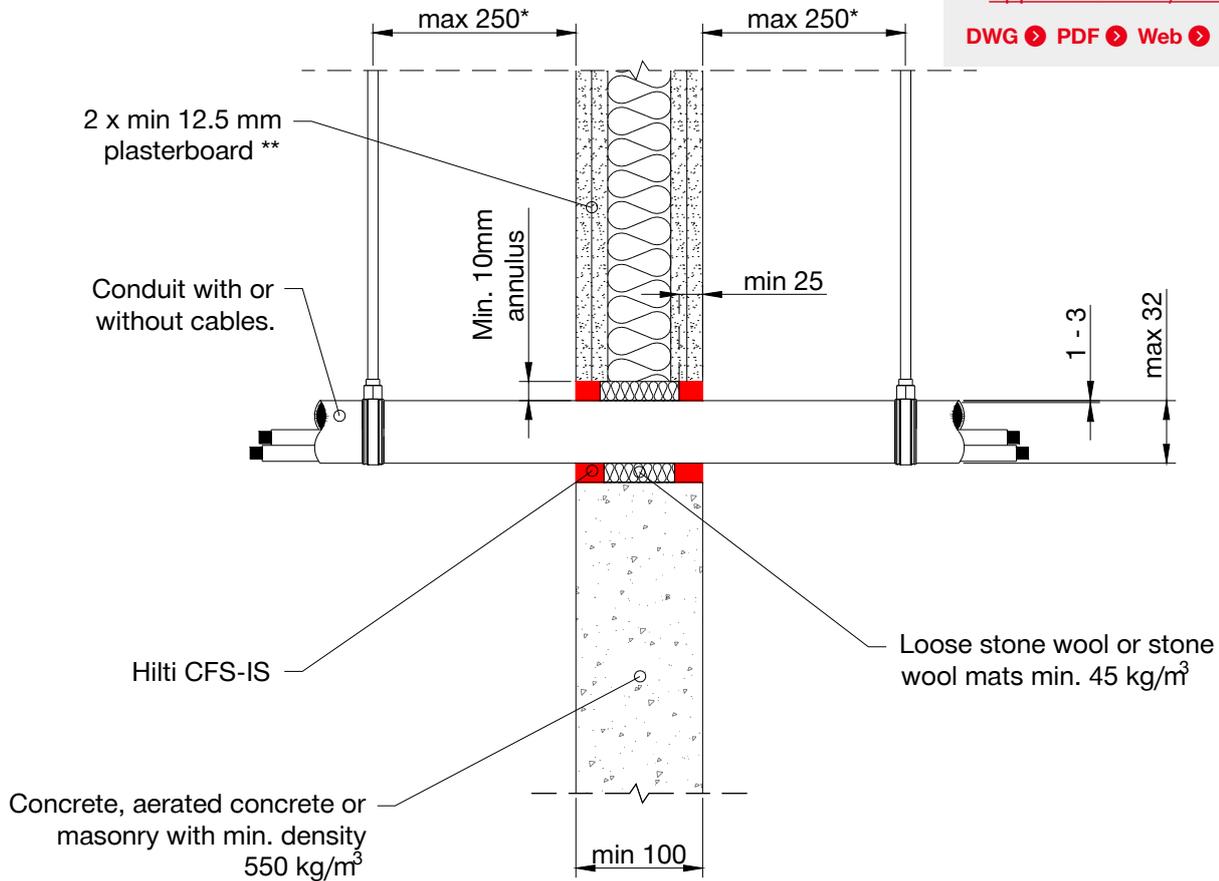

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm)
 Min. 100mm distance to other firestopping penetrations and timber studs. Min. 200mm to other penetrations (e.g., doors, windows etc.)

Multiple Conduits

Conduit Type / Ø	Classification
Small Steel ≤ Ø16, arranged linear	EI 120 C/U
Small Steel ≤ Ø16, arranged linear	EI 120-U/C
Plastic, diameter 16 ≤ Ø 16 ≤ 32, wall thickness 1-3, arranged linear or in cluster	EI 120-U/C

All sheathed cable types currently and commonly used in building practice in Europe (e.g., power, control, signal, telecommunication, data, optical fibre).

* First support and ancillary products should be capable of achieving the same fire performance as the seal and supporting structure.

** Comprising of timber or steel studs. Wall construction itself has been classified according to EN 13501-2.

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

IS: SP-FW/RW-E-02



MULTIPLE CONDUITS WITHIN FLEXIBLE AND RIGID WALLS

Fire rating up to EI 120

Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG ▶ PDF ▶ Web ▶

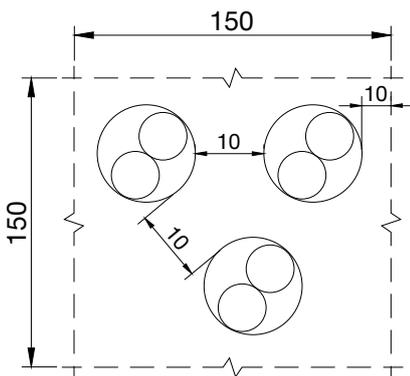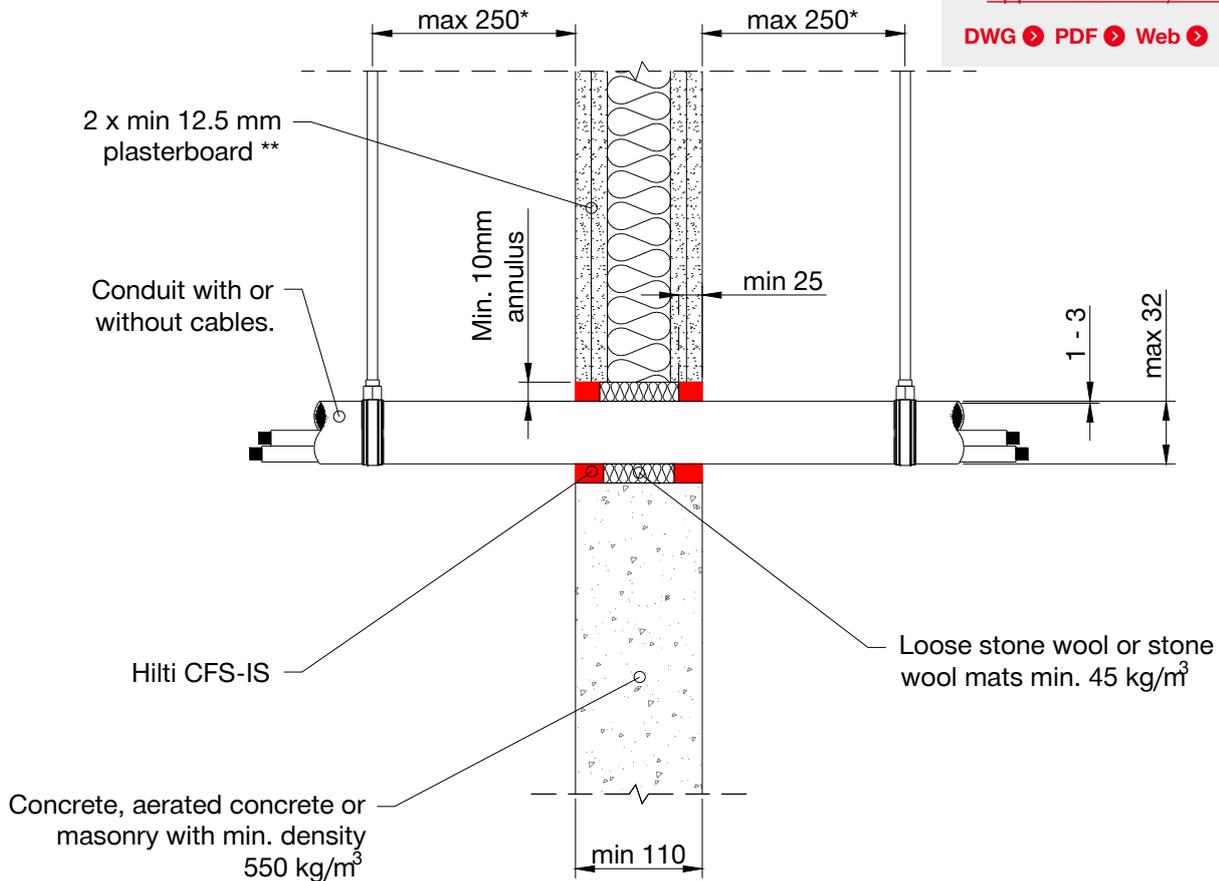

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm)
 Min. 100mm distance to other firestopping penetrations and timber studs. Min. 200mm to other penetrations (e.g., doors, windows etc.)

Ridgid, flexible and pliable plastic conduits	Classification
Rigid, flexible and pliable plastic conduit up to Ø 40 mm with or without cables and conduits used pairwise up to Ø 80 mm; Flexible PVC conduit or PO conduit, wavehight 4,5 mm	EI 120 U/U
Rigid, flexible and pliable plastic conduit up to Ø 40 mm with or without cables and conduits used pairwise up to Ø 80 mm	EI 120 U/U

All sheathed cable types currently and commonly used in building practice in Europe (e.g., power, control, signal, telecommunication, data, optical fibre).

* First support and ancillary products should be capable of achieving the same fire performance as the seal and supporting structure.

** Comprising of timber or steel studs. Wall construction itself has been classified according to EN 13501-2.

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

◀ Back

IS: SP-FW/RW-M-01


ALUMINIUM COMPOSITE PIPES WITH LOCAL SUSTAINED INSULATION

Fire rating up to EI 120


Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG ▶ PDF ▶ Web ▶

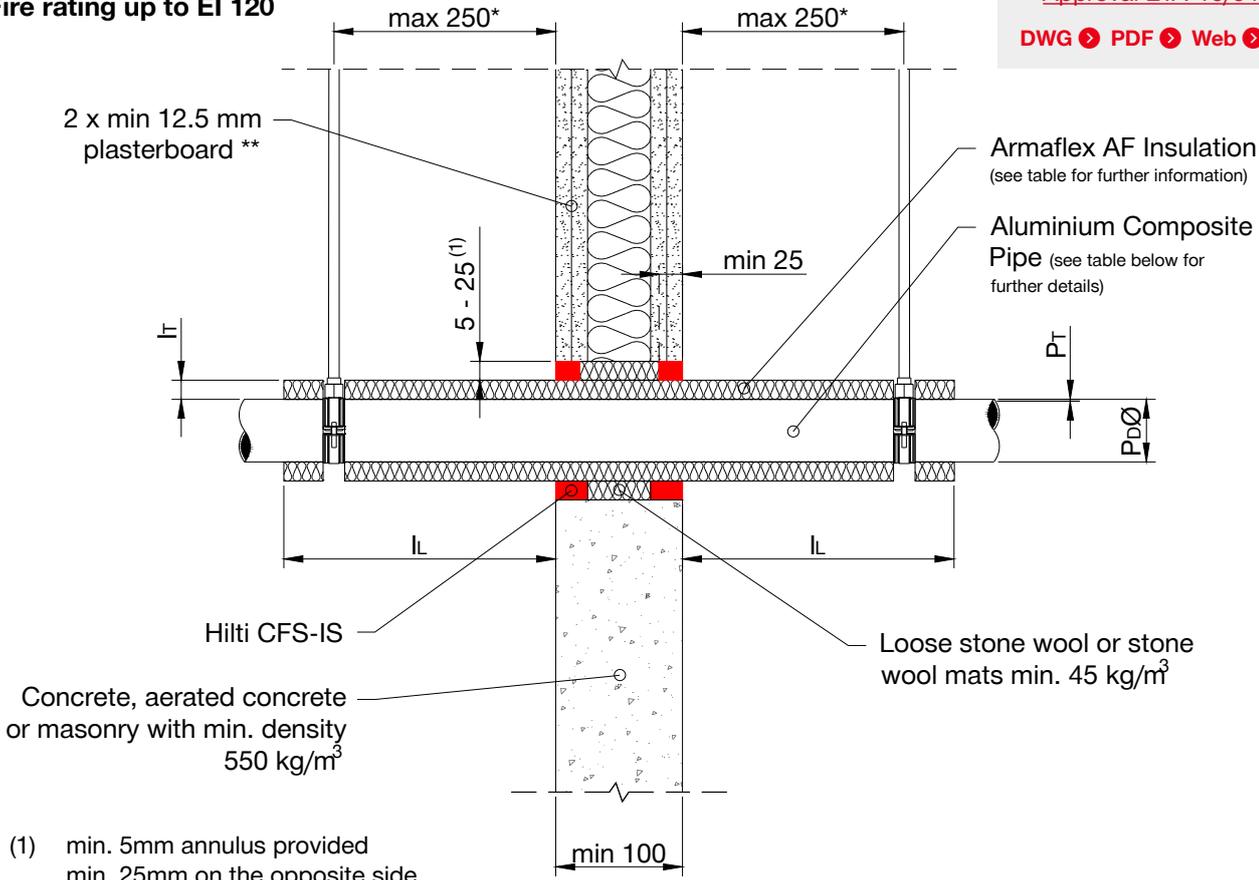

(1) min. 5mm annulus provided
min. 25mm on the opposite side

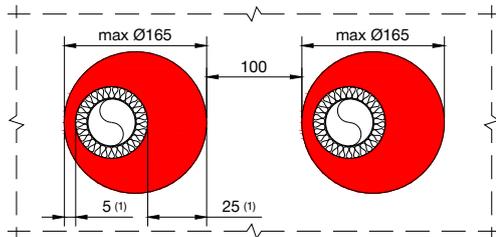

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm). Min. 100mm distance to other firestopping penetrations and timber studs. Min. 200mm to other penetrations (e.g., doors, windows etc.)

* First support and ancillary products should be capable of achieving the same fire performance as the seal and supporting structure.

** Comprising of timber or steel studs. Wall construction itself has been classified according to EN 13501-2.

Pipe		Insulation		Classification
P _D Ø	P _T	I _r	I _L	
Geberit Mepla (PE-XD/Al/PE-HD)***				
≥ 16-50	2.25-4.0	8-21	≥ 250	EI 90 U/C
Kelkelit Kelox (PE-XB/Al)***				
16	2.0	8-17	≥ 250	EI 120 U/C
≥ 16-50	2.0-4.0	8-21	≥ 250	EI 90 U/C
LK Schewnden (PE-RT/Al/PE-RT)***				
16-40	2.0-3.5	8-21	≥ 250	EI 90 U/C
Uponor Uni Pipe Plus (PE-RT/Al)***				
≥ 16-32	2.0-3.5	8-19.5	≥ 250	EI 90 U/C
The above LS Insulation parameters are also valid for CS				
***All Insulation is Armaflex AF Insulation				

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

◀ Back

IS: SP-FW/RW-M-01


ALUMINIUM COMPOSITE PIPES WITH LOCAL SUSTAINED INSULATION

Fire rating up to EI 120


Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG ▶ PDF ▶ Web ▶

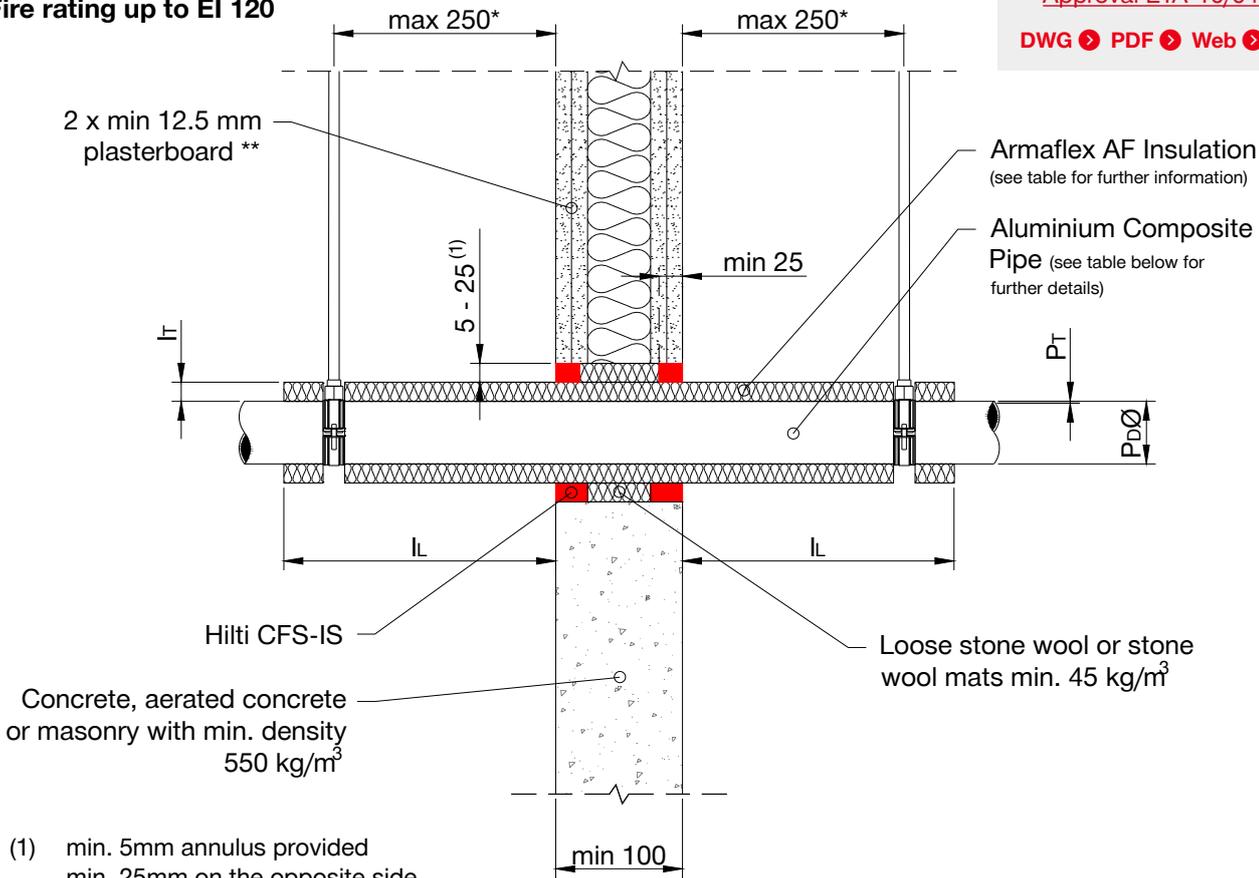

(1) min. 5mm annulus provided
min. 25mm on the opposite side

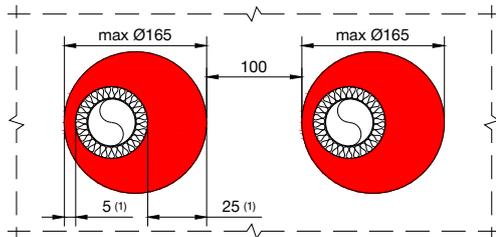

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm). Min. 100mm distance to other firestopping penetrations and timber studs. Min. 200mm to other penetrations (e.g., doors, windows etc.)

* First support and ancillary products should be capable of achieving the same fire performance as the seal and supporting structure.

** Comprising of timber or steel studs. Wall construction itself has been classified according to EN 13501-2.

Pipe		Insulation		Classification
P _D Ø	P _T	I _r	I _L	
Geberit Mepla (PE-XD/Al/PE-HD)***				
≥ 16-50	2.25-4.0	8-21	≥ 250	EI 90 U/C
Kelkelit Kelox (PE-XB/Al)***				
16	2.0	8-17	≥ 250	EI 120 U/C
≥ 16-50	2.0-4.0	8-21	≥ 250	EI 90 U/C
LK Schewnden (PE-RT/Al/PE-RT)***				
16-40	2.0-3.5	8-21	≥ 250	EI 90 U/C
Uponor Uni Pipe Plus (PE-RT/Al)***				
≥ 16-32	2.0-3.5	8-19.5	≥ 250	EI 90 U/C
The above LS Insulation parameters are also valid for CS				
***All Insulation is Armaflex AF Insulation				

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

◀ Back

IS: SP-FW/RW-M-02


ALUMINIUM COMPOSITE PIPES WITH NO INSULATION

Fire rating up to EI 120


Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG ▶ PDF ▶ Web ▶

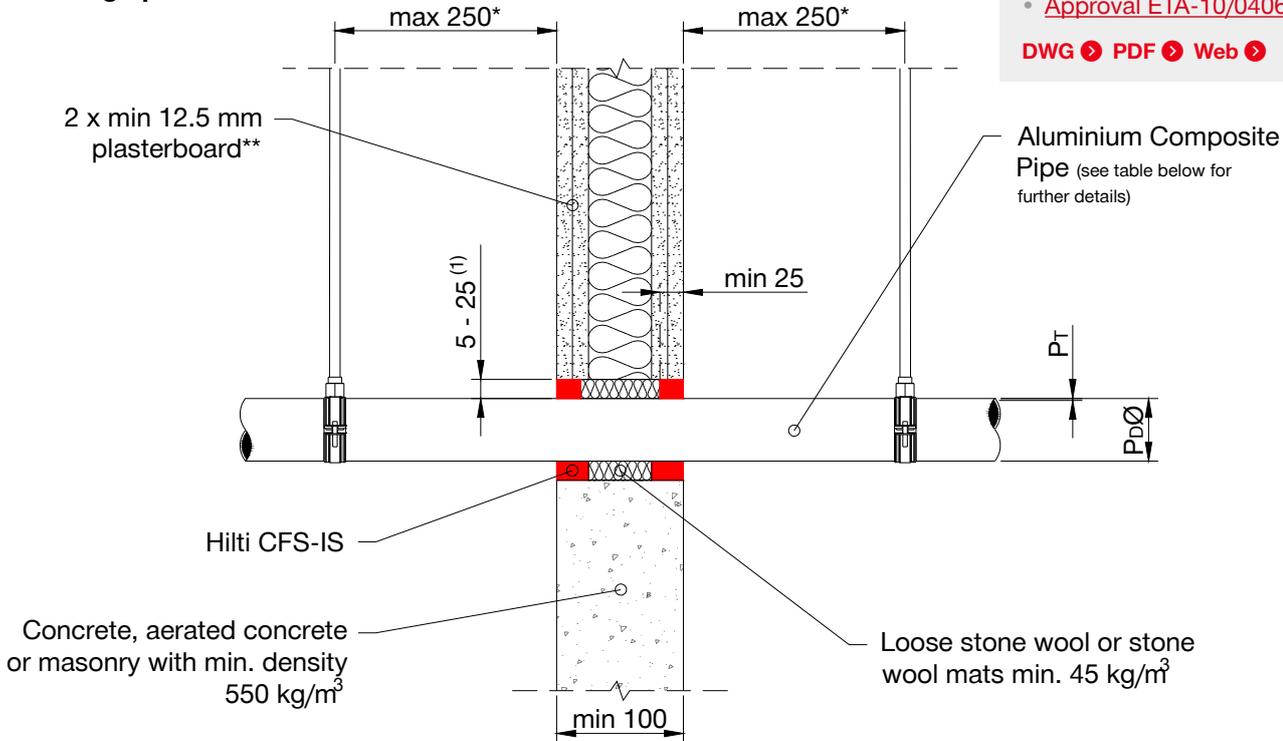

- (1) min. 5mm annulus provided
min. 25mm on the opposite side

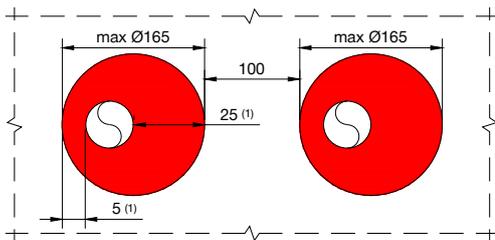

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm). Min. 100mm distance to other firestopping penetrations and timber studs. Min. 200mm to other penetrations (e.g., doors, windows etc.)

* First support and ancillary products should be capable of achieving the same fire performance as the seal and supporting structure.

** Comprising of timber or steel studs. Wall construction itself has been classified according to EN 13501-2.

PbØ	Pipe	P _T	Classification
	Geberit Mepla (PE-XD/Al/PE-HD)		
≥ 16-50		2.25-4.0	EI 60 U/C
	Geberit Silent (PP-C/P-MD)		
≥ 32-50		2.0	EI 90 U/C
	Kelkelit Kelox (PE-XB/Al/PE-XB)		
16		2.0	EI 120 U/C
≥ 16-50		2.0-4.0	EI 90 U/C
	LK Schewnden (PE-RT/Al/PE-RT)		
16-40		2.0-3.5	EI 60 U/C
	Uponor Uni Pipe Plus (PE-RT/Al)		
≥ 16-32		2.0-3.5	EI 60 U/C
	PP Life Master 3 (MM-CO/PP-MV, EN1451-1)		
≥ 32-40		1.8	EI 120 U/U
50		1.8	EI 90 U/C

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

◀ Back

IS: SP-FW/RW-M-02


ALUMINIUM COMPOSITE PIPES WITH NO INSULATION

Fire rating up to EI 120


Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG [▶](#) PDF [▶](#) Web [▶](#)

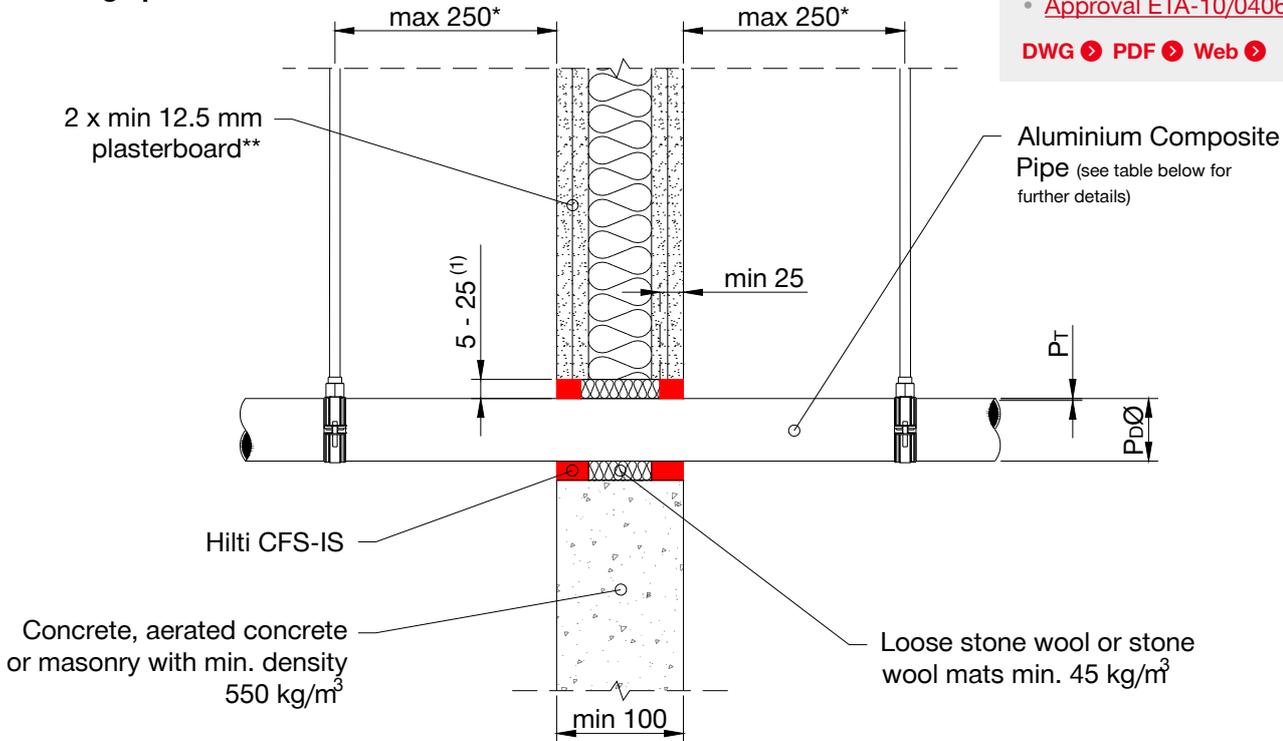

- (1) min. 5mm annulus provided
min. 25mm on the opposite side

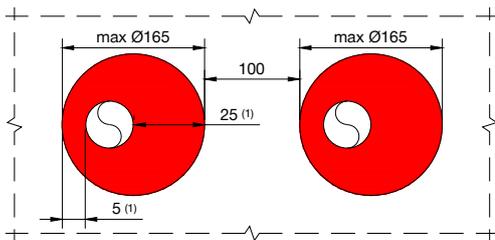

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm). Min. 100mm distance to other firestopping penetrations and timber studs. Min. 200mm to other penetrations (e.g., doors, windows etc.)

* First support and ancillary products should be capable of achieving the same fire performance as the seal and supporting structure.

** Comprising of timber or steel studs. Wall construction itself has been classified according to EN 13501-2.

PbØ	Pipe	P _T	Classification
	Geberit Mepla (PE-XD/Al/PE-HD)		
≥ 16-50		2.25-4.0	EI 60 U/C
	Geberit Silent (PP-C/P-MD)		
≥ 32-50		2.0	EI 90 U/C
	Kelkelit Kelox (PE-XB/Al/PE-XB)		
16		2.0	EI 120 U/C
≥ 16-50		2.0-4.0	EI 90 U/C
	LK Schewnden (PE-RT/Al/PE-RT)		
16-40		2.0-3.5	EI 60 U/C
	Uponor Uni Pipe Plus (PE-RT/Al)		
≥ 16-32		2.0-3.5	EI 60 U/C
	PP Life Master 3 (MM-CO/PP-MV, EN1451-1)		
≥ 32-40		1.8	EI 120 U/U
50		1.8	EI 90 U/C

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

◀ Back

IS: SP-FW/RW-M-03


PVC PIPES WITH NO INSULATION

Fire rating up to EI 120


Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG [▶](#) PDF [▶](#) Web [▶](#)

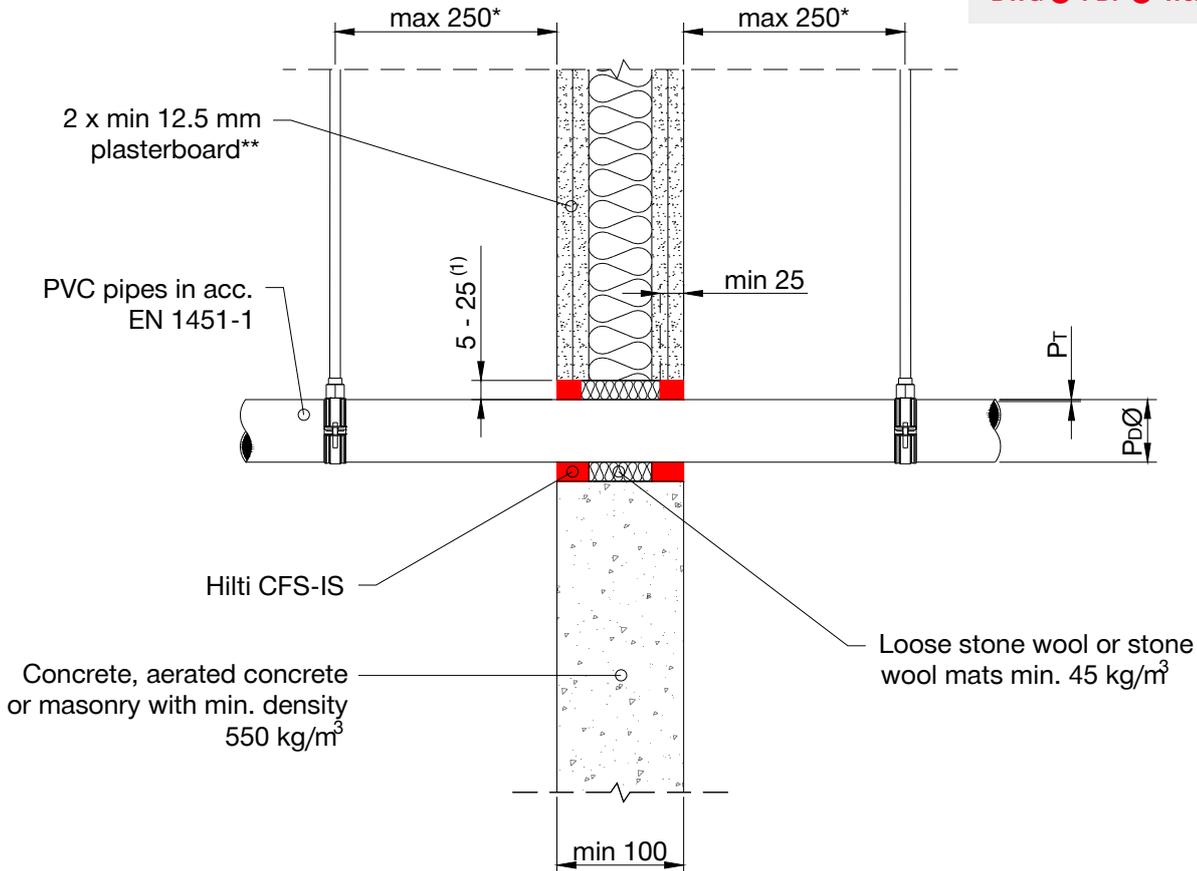

(1) min. 5mm annulus provided
min. 25mm on the opposite side

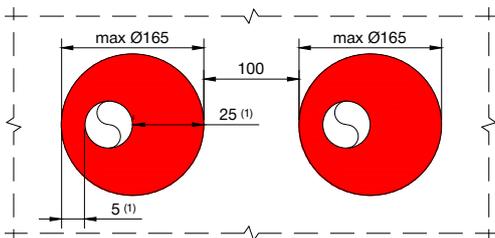

PVC pipe		
P _b Ø	P _T	Classification
≥ Ø16 – 20	1.8-2.2	EI 120 U/U
32	1.8-3.6	EI 60 U/U
≥ Ø34 – 40	1.9-3.6	EI 90 U/U
≥ Ø40 – 50	1.9-3.7	EI 90 U/C

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm). Min. 100mm distance to other firestopping penetrations and timber studs. Min. 200mm to other penetrations (e.g., doors, windows etc.)

* First support and ancillary products should be capable of achieving the same fire performance as the seal and supporting structure.

** Comprising of timber or steel studs. Wall construction itself has been classified according to EN 13501-2.

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
4. All services are to be correctly and adequately supported to prevent collapse and distortion.

◀ Back

IS: SP-FW/RW-M-03


PVC PIPES WITH NO INSULATION

Fire rating up to EI 120


Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG [▶](#) PDF [▶](#) Web [▶](#)

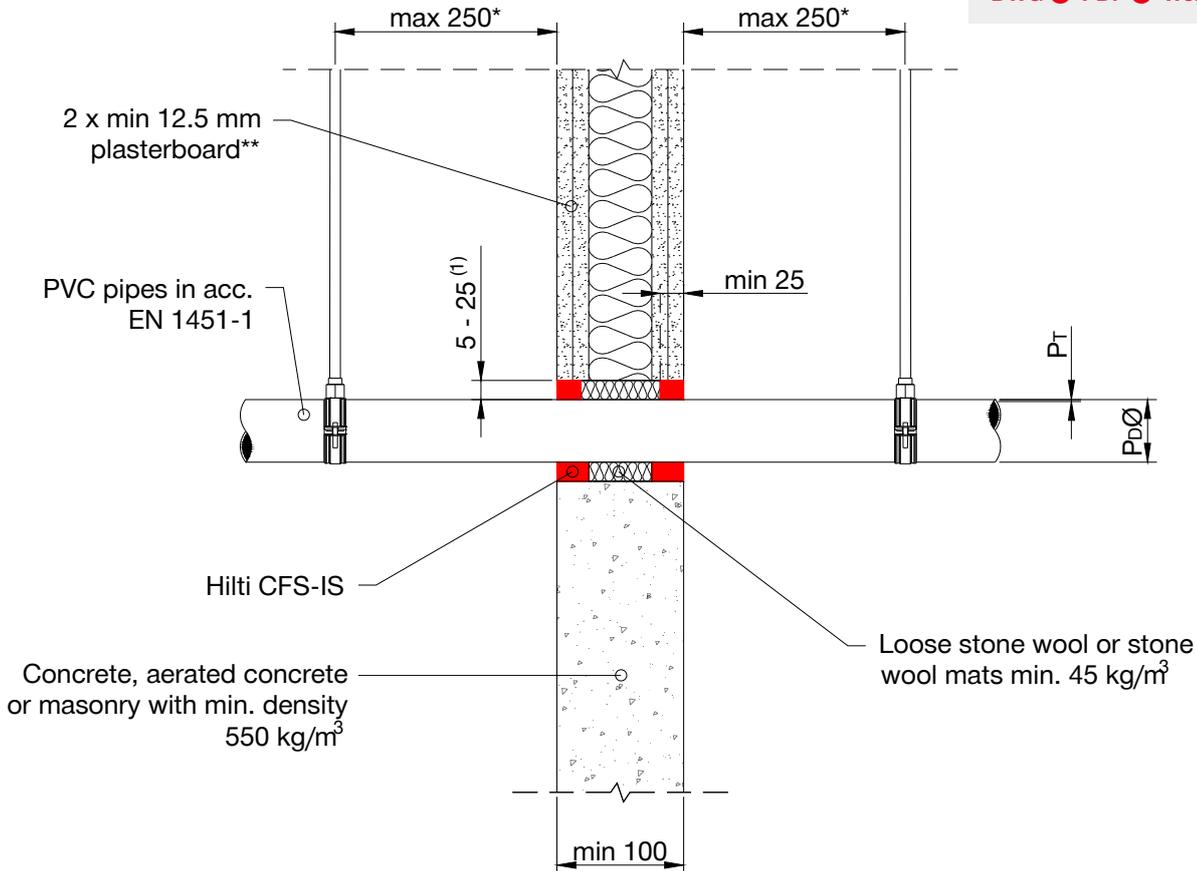

(1) min. 5mm annulus provided
min. 25mm on the opposite side

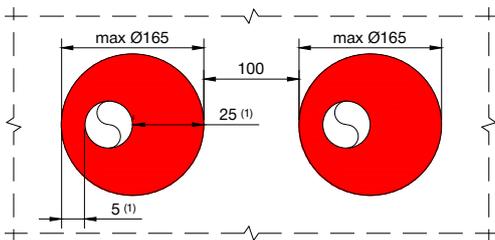

PVC pipe		
P _b Ø	P _T	Classification
≥ Ø16 – 20	1.8-2.2	EI 120 U/U
32	1.8-3.6	EI 60 U/U
≥ Ø34 – 40	1.9-3.6	EI 90 U/U
≥ Ø40 – 50	1.9-3.7	EI 90 U/C

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm). Min. 100mm distance to other firestopping penetrations and timber studs. Min. 200mm to other penetrations (e.g., doors, windows etc.)

* First support and ancillary products should be capable of achieving the same fire performance as the seal and supporting structure.

** Comprising of timber or steel studs. Wall construction itself has been classified according to EN 13501-2.

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

IS: SP-FW/RW-M-04


METAL PIPES WITH LOCALLY SUSTAINED INSULATION

Fire rating up to EI 120


Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG [▶](#) PDF [▶](#) Web [▶](#)

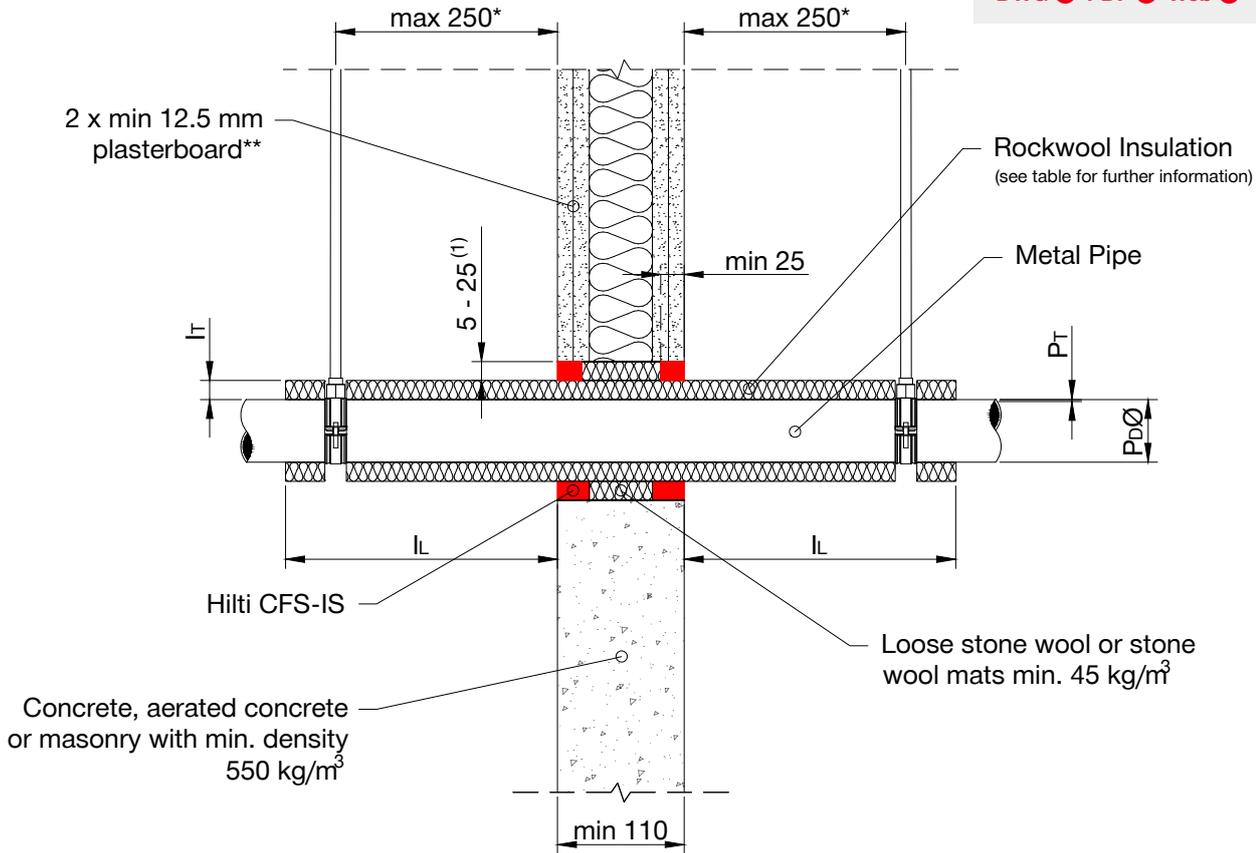

- (1) min. 5mm annulus provided
min. 25mm on the opposite side

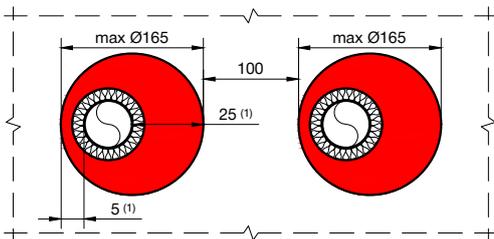

Pipe		Insulation		Classification
P _b Ø	P _T	I _r	I _L	
Copper/Steel Pipes (LS) with Rockwool RS 800				
≥ 10-42	1.0 / 1.2-14.2	20	≥ 700	EI 120 C/U
≥ 42-89	1.0 / 1.2-14.2	40	≥ 925	EI 120 C/U

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm). Min. 100mm distance to other firestopping penetrations and timber studs. Min. 200mm to other penetrations (e.g., doors, windows etc.)

- * First support and ancillary products should be capable of achieving the same fire performance as the seal and supporting structure.
- ** Comprising of timber or steel studs. Wall construction itself has been classified according to EN 13501-2.

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

IS: SP-FW/RW-M-04


METAL PIPES WITH LOCALLY SUSTAINED INSULATION

Fire rating up to EI 120


Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG [▶](#) PDF [▶](#) Web [▶](#)

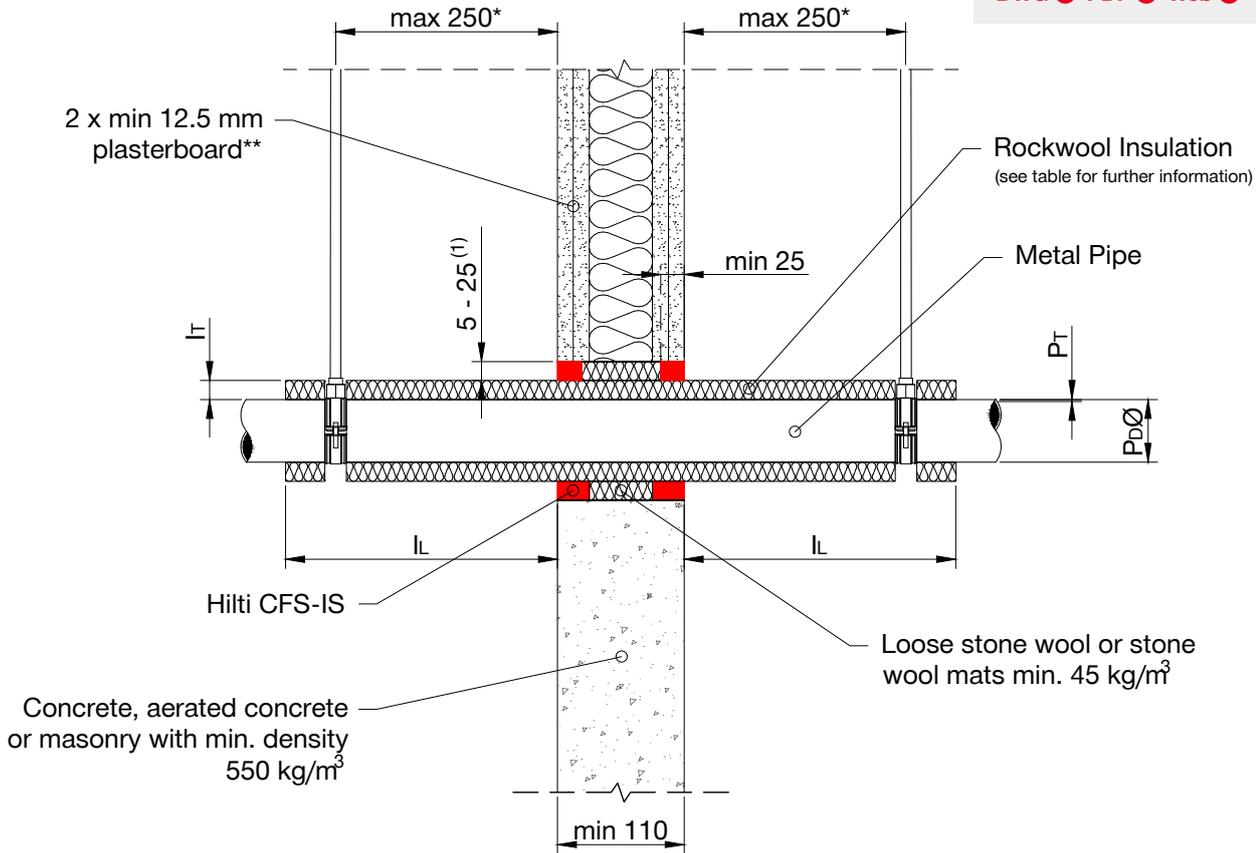

- (1) min. 5mm annulus provided
min. 25mm on the opposite side

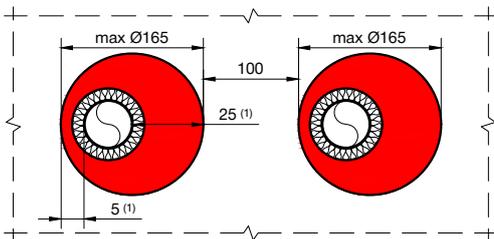

Pipe		Insulation		Classification
P _b Ø	P _T	l _T	l _L	
Copper/Steel Pipes (LS) with Rockwool RS 800				
≥ 10-42	1.0 / 1.2-14.2	20	≥ 700	EI 120 C/U
≥ 42-89	1.0 / 1.2-14.2	40	≥ 925	EI 120 C/U

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm). Min. 100mm distance to other firestopping penetrations and timber studs. Min. 200mm to other penetrations (e.g., doors, windows etc.)

- * First support and ancillary products should be capable of achieving the same fire performance as the seal and supporting structure.
- ** Comprising of timber or steel studs. Wall construction itself has been classified according to EN 13501-2.

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

IS: SP-FW/RW-M-04


METAL PIPES WITH CONTINUOUS SUSTAINED INSULATION

Fire rating up to EI 120


Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG PDF Web

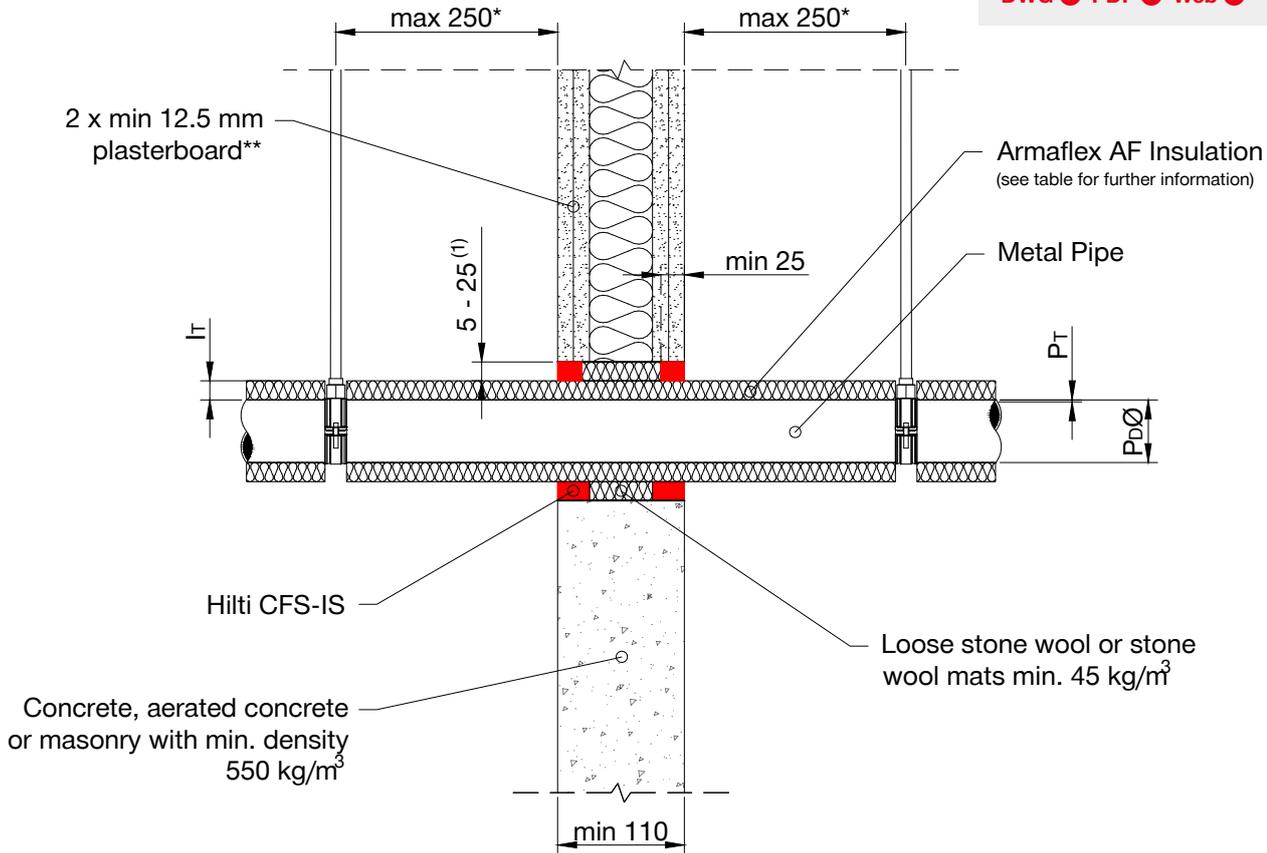

- (1) min. 5mm annulus provided
min. 25mm on the opposite side

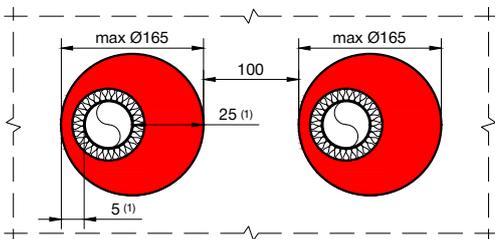

Pipe P _b Ø	Pipe P _T	Insulation I _T	Classification
Copper/Steel Pipes (CS) with Armaflex AF			
≥ 10-42	1.0 / 1.2-14.2	7.5-20.5	EI 120 C/U
≥ 42-89	1.0 / 1.2-14.2	14.5-22.5	EI 60 C/U

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm). Min. 100mm distance to other firestopping penetrations and timber studs. Min. 200mm to other penetrations (e.g., doors, windows etc.)

- * First support and ancillary products should be capable of achieving the same fire performance as the seal and supporting structure.
- ** Comprising of timber or steel studs. Wall construction itself has been classified according to EN 13501-2.

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
4. All services are to be correctly and adequately supported to prevent collapse and distortion.

IS: SP-FW/RW-M-04


METAL PIPES WITH CONTINUOUS SUSTAINED INSULATION

Fire rating up to EI 120


Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG PDF Web

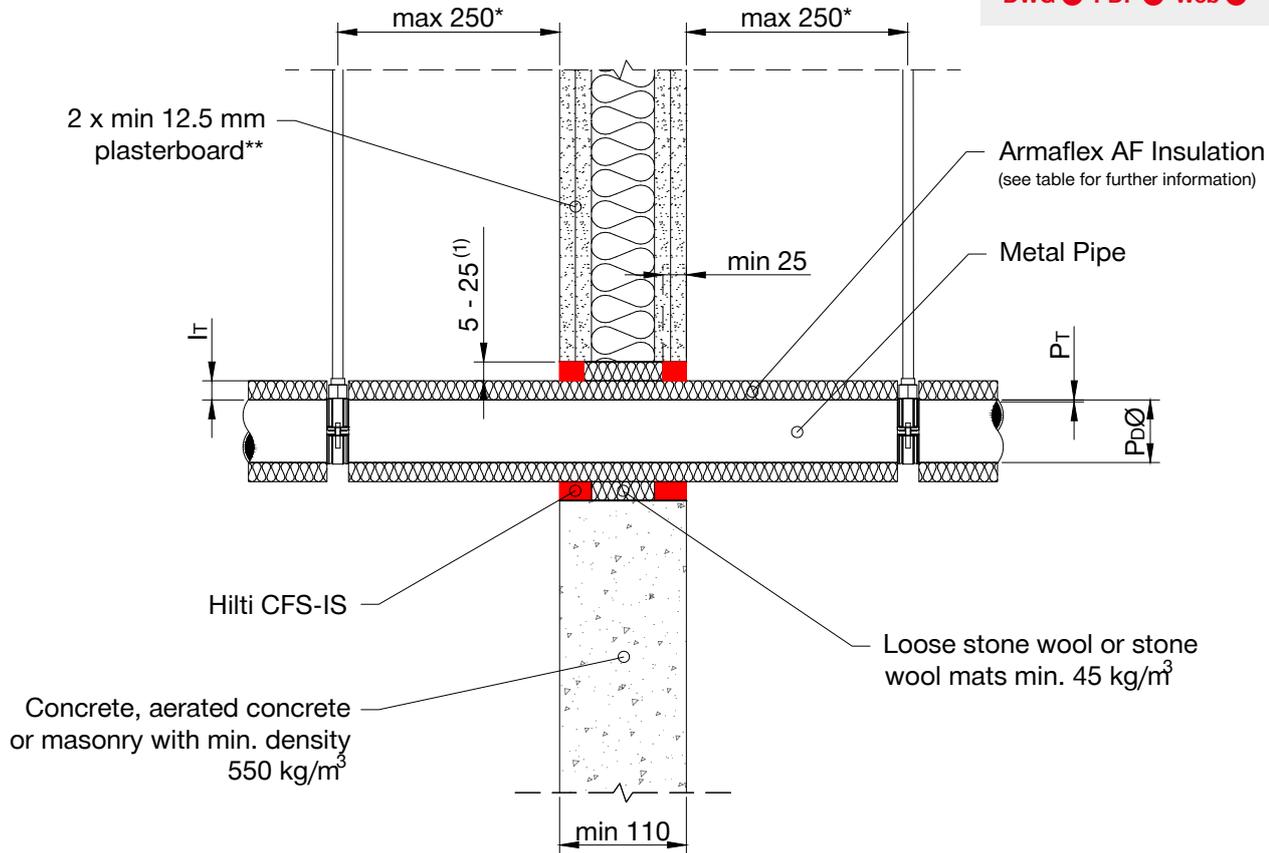

- (1) min. 5mm annulus provided
min. 25mm on the opposite side

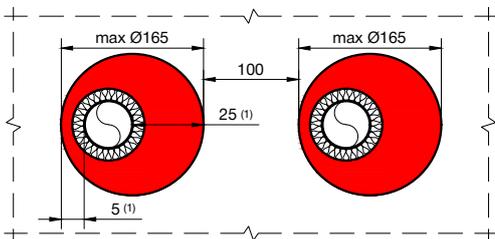

Pipe PdØ	Pipe P _T	Insulation I _T	Classification
Copper/Steel Pipes (CS) with Armaflex AF			
≥ 10-42	1.0 / 1.2-14.2	7.5-20.5	EI 120 C/U
≥ 42-89	1.0 / 1.2-14.2	14.5-22.5	EI 60 C/U

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm). Min. 100mm distance to other firestopping penetrations and timber studs. Min. 200mm to other penetrations (e.g., doors, windows etc.)

- * First support and ancillary products should be capable of achieving the same fire performance as the seal and supporting structure.
- ** Comprising of timber or steel studs. Wall construction itself has been classified according to EN 13501-2.

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

◀ Back

IS: SP-RW-M-01


PVC PIPES WITH NO INSULATION

Fire rating up to EI 120


Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG [▶](#) PDF [▶](#) Web [▶](#)

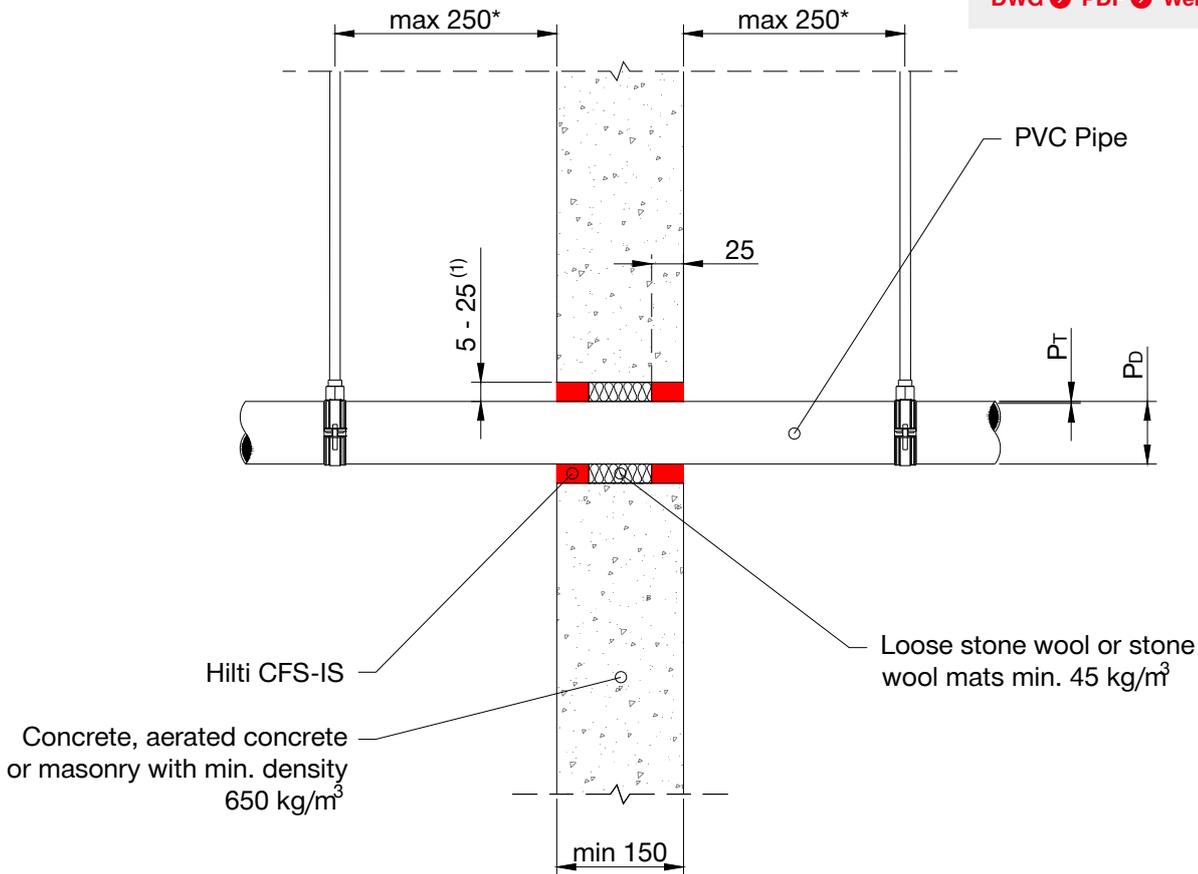

- (1) min. 5mm annulus provided
min. 25mm on the opposite side

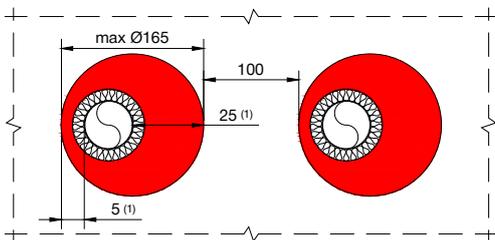

PVC pipe (EN1451-1)		
$P_D \varnothing$	P_T	Classification
$\geq \varnothing 32 - 50$	1.8-2.2-6.4	EI 180 U/U

Max opening size 150mm x 150mm or circular openings of equivalent area ($\varnothing 165$ mm). Min. 100mm distance to other firestopping penetrations and timber studs. Min. 200mm to other penetrations (e.g., doors, windows etc.)

* First support and ancillary products should be capable of achieving the same fire performance as the seal and supporting structure.

** Comprising of timber or steel studs. Wall construction itself has been classified according to EN 13501-2.

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
4. All services are to be correctly and adequately supported to prevent collapse and distortion.

Hilti (Gt. Britain) Limited | No 1, Circle Square | 3 Symphony Park | Manchester | M1 7FS Freephone: 0800 886 100 | Website: www.hilti.co.uk

LEGAL NOTICE: This template contains Hilti Intellectual Property which is legally protected, including Community registration of Hilti trademarks. For use only by Hilti customers and in conjunction with Hilti products. No third party use/products is authorised and breaches Hilti's intellectual property rights. Hilti accepts no responsibility for unauthorized use and reserves all rights to take legal action to enforce its rights in law.

IS: SP-RW-E-01


CABLES WITHIN RIGID WALLS

Fire rating up to EI 120

Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG ▶ PDF ▶ Web ▶

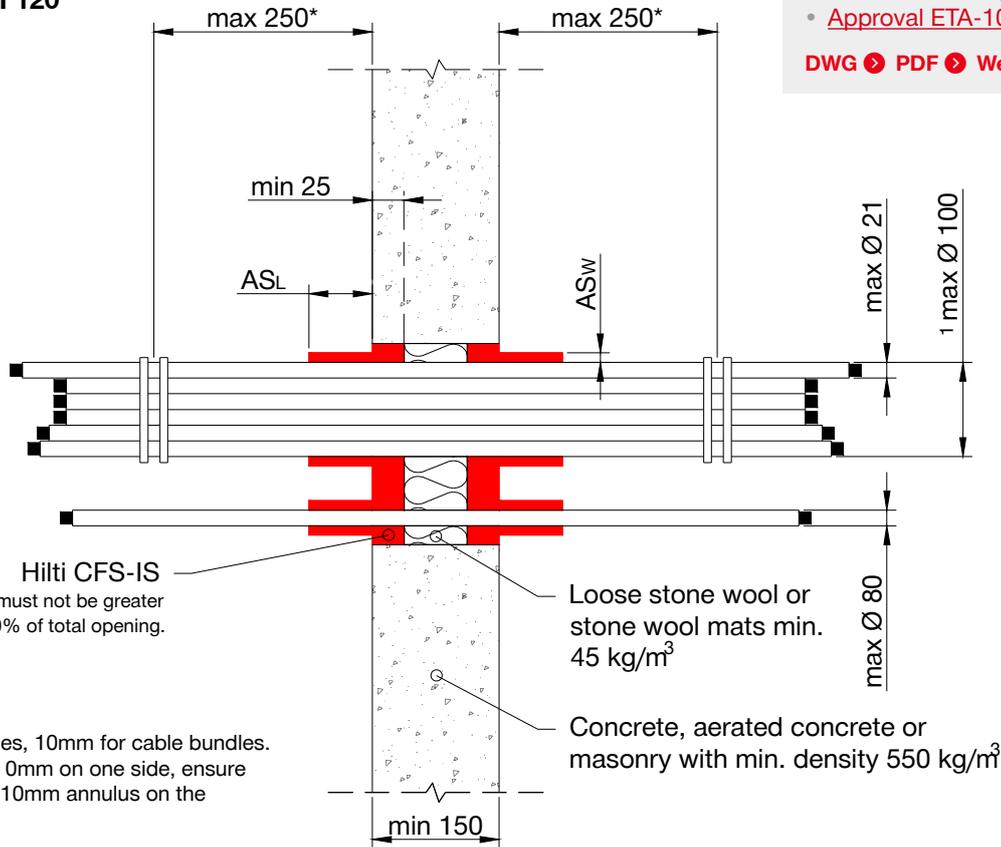

Hilti CFS-IS


Max Cable fill content must not be greater than 60% of total opening.

Loose stone wool or stone wool mats min. 45 kg/m³

Concrete, aerated concrete or masonry with min. density 550 kg/m³

Annular gap note:

- 0mm for single cables, 10mm for cable bundles.
- If the annular gap is 0mm on one side, ensure there is a minimum 10mm annulus on the opposite side.

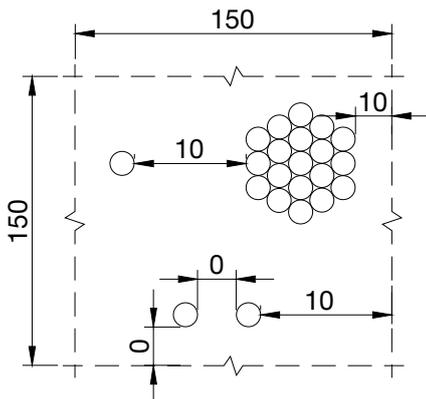

Cable Type / Ø	ASw	ASL	Classification
Max. Ø21	10	50	EI 120
	10	100	EI 120
21 ≤ Ø 80	10	50	EI 120
	10	100	EI 120
1 Tied cable bundle of max. Ø100, with max. single cable Ø21	10	50	EI 120
	10	100	EI 120

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm).

Min. 100mm distance to other firestopping penetrations and timber studs.

Min. 200mm to other penetrations (e.g., doors, windows etc.)

All sheathed cable types currently and commonly used in building practice in Europe (e.g., power, control, signal, telecommunication, data, optical fibre).

* First support and ancillary products should be capable of achieving the same fire performance as the seal and supporting structure.

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

IS: SP-RW-E-01


CABLES WITHIN RIGID WALLS

Fire rating up to EI 120

Information


- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG ▶ PDF ▶ Web ▶

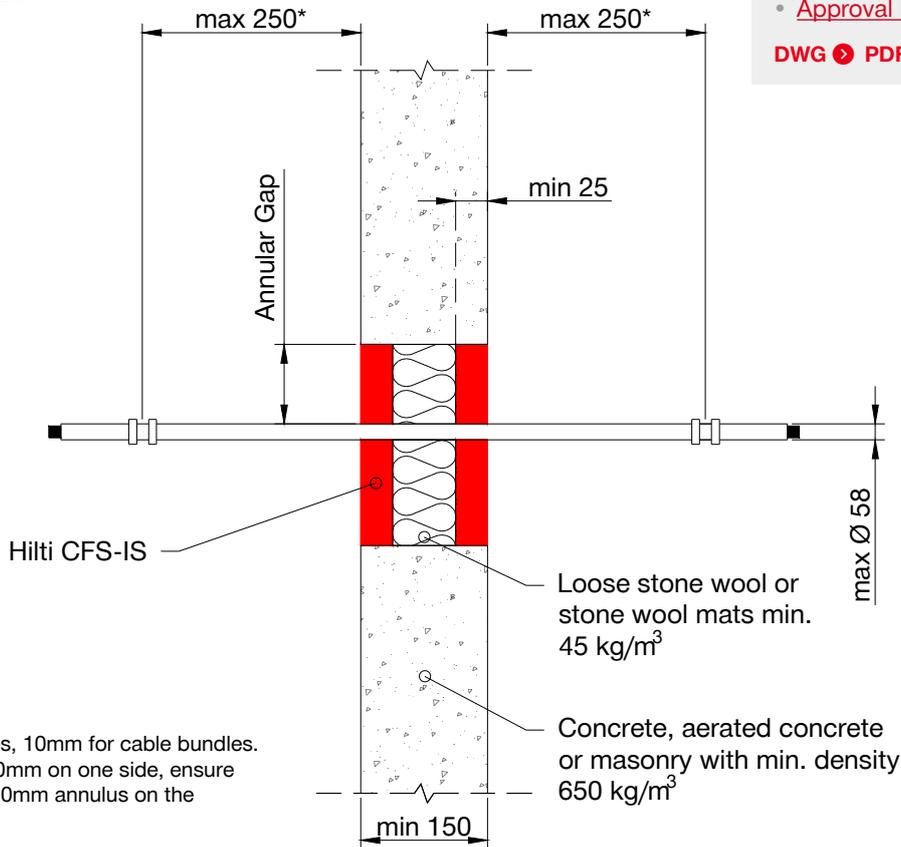

Annular gap note:

- 0mm for single cables, 10mm for cable bundles.
- If the annular gap is 0mm on one side, ensure there is a minimum 10mm annulus on the opposite side.

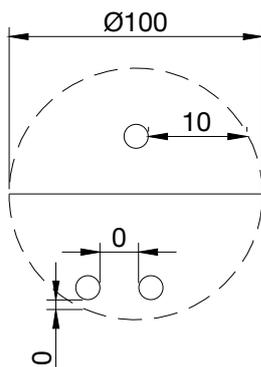

Max opening size Ø 100mm.

Min. 100mm distance to other firestopping penetrations and timber studs.

Min. 200mm to other penetrations (e.g., doors, windows etc.)

Cable Type / Ø (mm)	Classification
All sheathed cable types currently and commonly used in building practice in Europe (e.g., power, control, signal, telecommunication, data, optical fibre) with a max. Ø 13.8mm	EI 180
Diameter Max Ø58	EI 90
	EI 180

* First support and ancillary products should be capable of achieving the same fire performance as the seal and supporting structure.

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

IS: SP-RF-E-01


CABLES THROUGH RIGID FLOORS

Fire rating up to EI 120

Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)


DWG ▶ PDF ▶ Web ▶

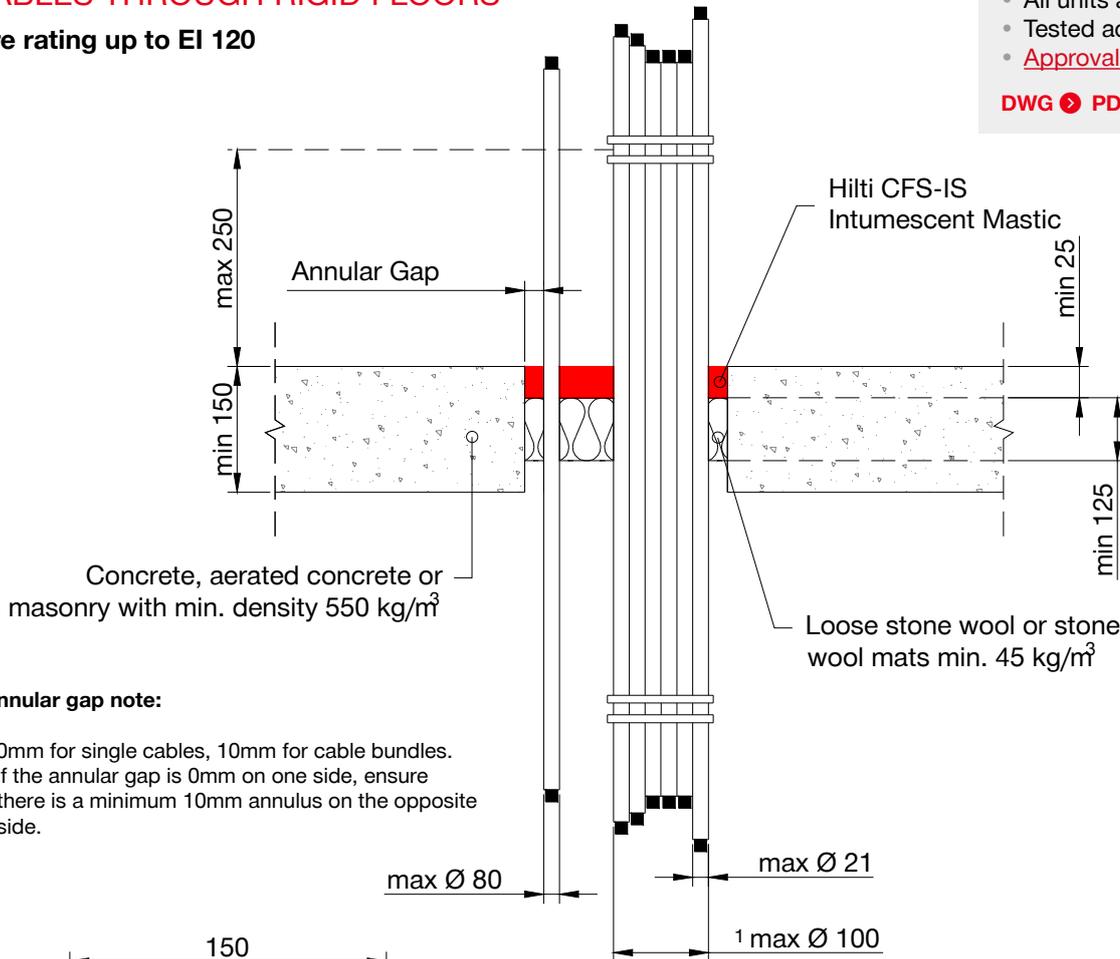

Concrete, aerated concrete or masonry with min. density 550 kg/m³

Annular gap note:

- 0mm for single cables, 10mm for cable bundles.
- If the annular gap is 0mm on one side, ensure there is a minimum 10mm annulus on the opposite side.

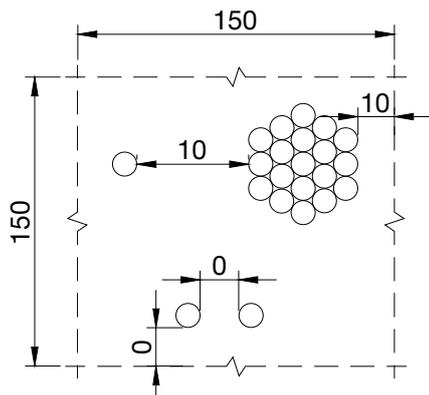

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm). Min. 100mm distance to other firestopping penetrations and timber studs. Min. 200mm to other penetrations (e.g., doors, windows etc.)

Cable Type / Ø	Classification
Max. Ø21	EI 120
21 ≤ Ø 80	EI 60 EI 120
¹ Tied cable bundle of max. Ø100, with max. single cable Ø21	EI 90 EI 120

All sheathed cable types currently and commonly used in building practice in Europe (e.g., power, control, signal, telecommunication, data, optical fibre)

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

IS: SP-RF-E-01


CABLES THROUGH RIGID FLOORS

Fire rating up to EI 120

Information


- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG ▶ PDF ▶ Web ▶

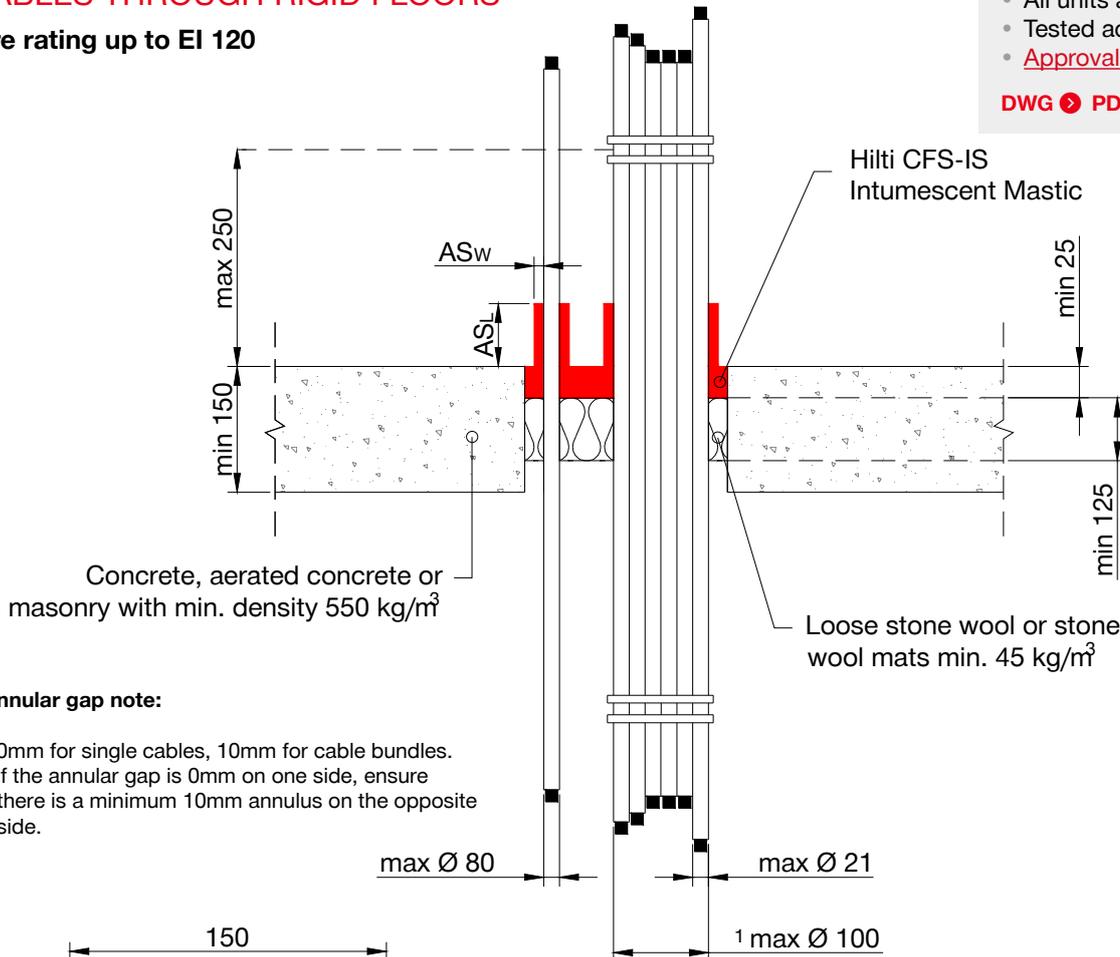

Annular gap note:

- 0mm for single cables, 10mm for cable bundles.
- If the annular gap is 0mm on one side, ensure there is a minimum 10mm annulus on the opposite side.

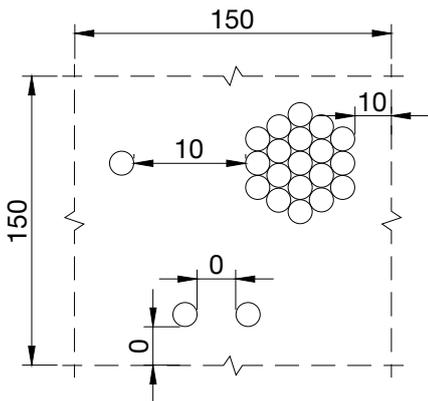

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm). Min. 100mm distance to other firestopping penetrations and timber studs. Min. 200mm to other penetrations (e.g., doors, windows etc.)

Cable Type / Ø	AS _w	AS _L	Classification
Max. Ø21	10	50	EI 120
	10	100	EI 120
	0	0	EI 120
21 ≤ Ø 80	10	50	EI 90
	10	100	EI 120
	0	0	EI 90
1 Tied cable bundle of max. Ø100, with max. single cable Ø21	10	50	EI 120
	10	100	EI 120
	0	0	EI 90

All sheathed cable types currently and commonly used in building practice in Europe (e.g., power, control, signal, telecommunication, data, optical fibre)

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

◀ Back

IS: SP-RF-E-03



PLASTIC CONDUITS THROUGH RIGID FLOORS

Fire rating up to EI 120

Information

- Not to scale
- All units are in millimetres
- Tested according to EN 1366-3
- [Approval ETA-10/0406](#)

DWG ▶ PDF ▶ Web ▶

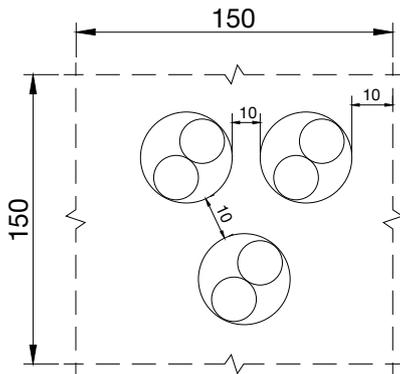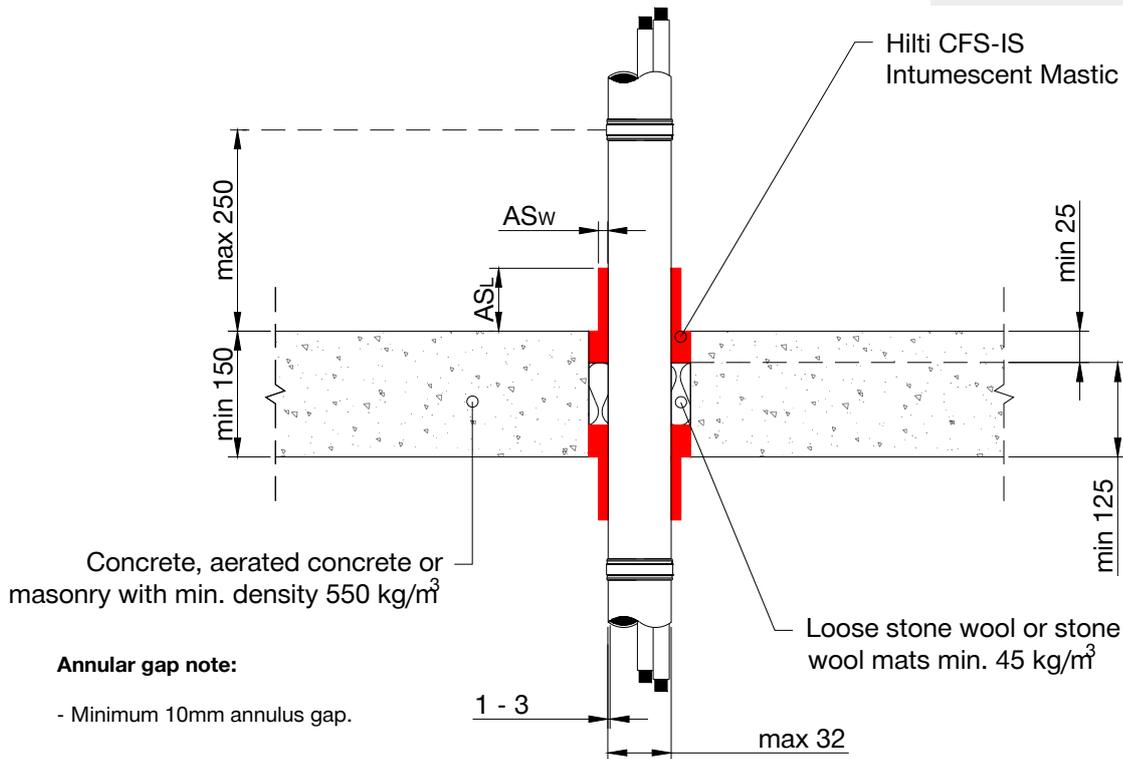

Conduit Type / Ø	ASw	ASL	Classification
Plastic conduits 16 ≤ Ø ≤ 32, wall thickness 1-3, arranged linear, with or without cables*	10	50	EI 120 U/C
	10	100	EI 120 U/C

*All sheathed cable types currently and commonly used in building practice in Europe (e.g., power, control, signal, telecommunication, data, optical fibre).

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm).

Min. 100mm distance to other firestopping penetrations and timber studs.

Min. 200mm to other penetrations (e.g., doors, windows etc.)

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
4. All services are to be correctly and adequately supported to prevent collapse and distortion.

IS: SP-RF-E-02



CONDUITS THROUGH RIGID FLOOR

Fire rating up to EI 120

Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG ▶ PDF ▶ Web ▶

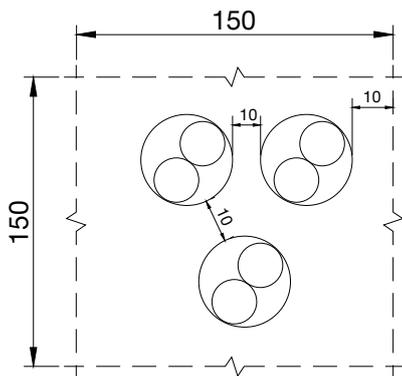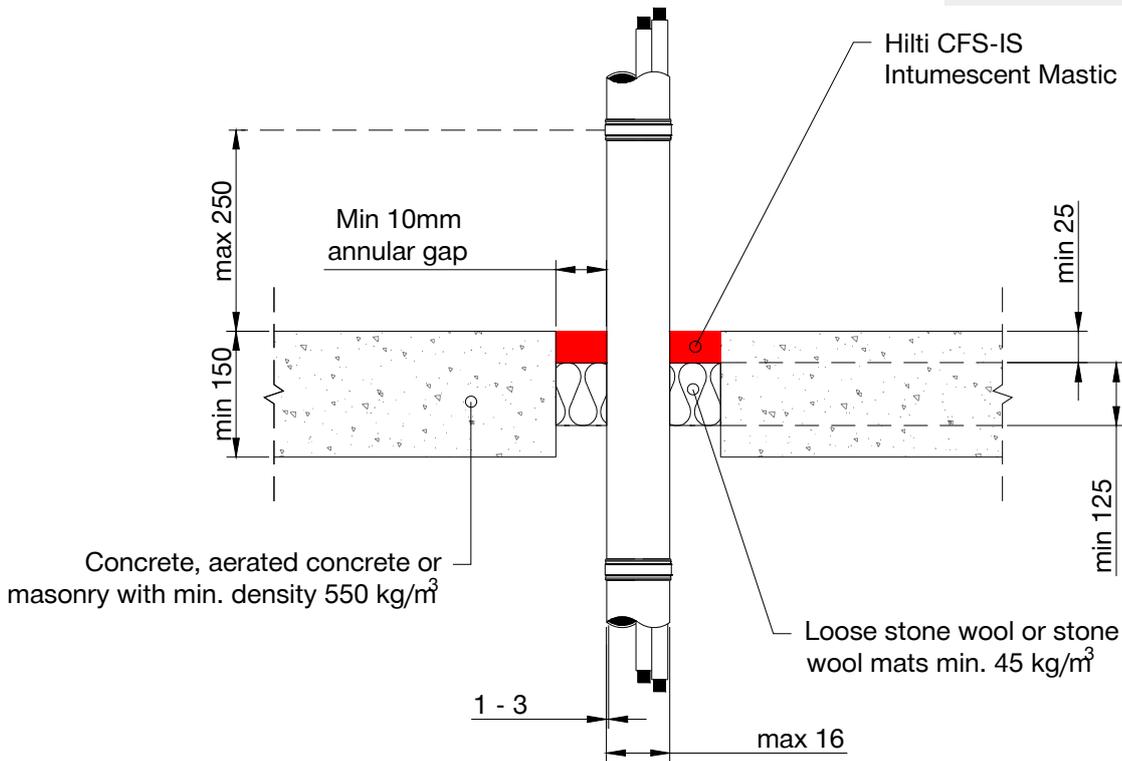

Conduit Type / Ø	Classification
Small steel conduits and tubes ≤ Ø 16, arranged linear, with or without cables*	EI 90 C/U
Small plastic conduits and tubes ≤ Ø 16, arranged linear, with or without cables*	EI 90 U/C

*All sheathed cable types currently and commonly used in building practice in Europe (e.g., power, control, signal, telecommunication, data, optical fibre).

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm).

Min. 100mm distance to other firestopping penetrations.

Min. 200mm to other penetrations (e.g., doors, windows etc.)

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

IS: SP-RF-E-02



CONDUITS THROUGH RIGID FLOOR

Fire rating up to EI 120

Information

- Not to scale
- All units are in millimetres
- Tested according to EN 1366-3
- [Approval ETA-10/0406](#)

DWG ▶ PDF ▶ Web ▶

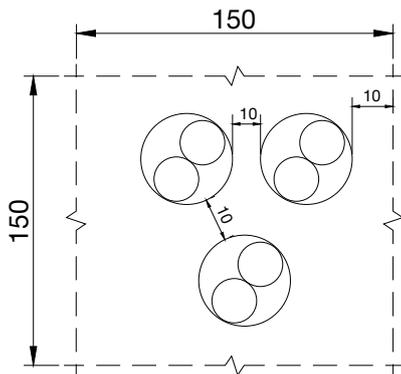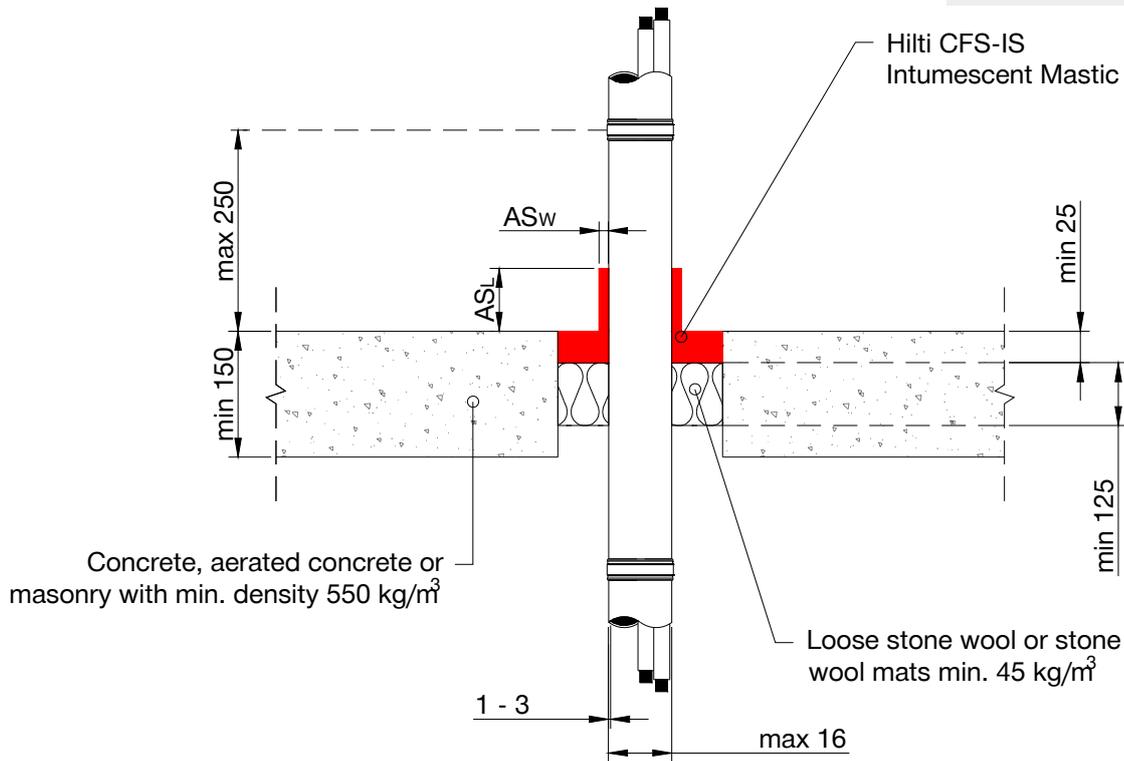

Cable Type / Ø	AS _w	AS _L	Classification
Small steel conduits and tubes ≤ Ø 16, arranged linear, with or without cables*	10	50	EI 120 C/U
	10	100	EI 120 C/U
Small plastic conduits and tubes ≤ Ø 16, arranged linear, with or without cables*	10	50	EI 120 U/C
	10	100	EI 120 U/C

*All sheathed cable types currently and commonly used in building practice in Europe (e.g., power, control, signal, telecommunication, data, optical fibre)

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm).

Min. 100mm distance to other firestopping penetrations.

Min. 200mm to other penetrations (e.g., doors, windows etc.)

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

◀ Back

IS: SP-RF-M-01


ALUMINIUM COMPOSITE PIPES WITH LOCALLY SUSTAINED INSULATION

Fire rating up to EI 120


Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG ▶ PDF ▶ Web ▶

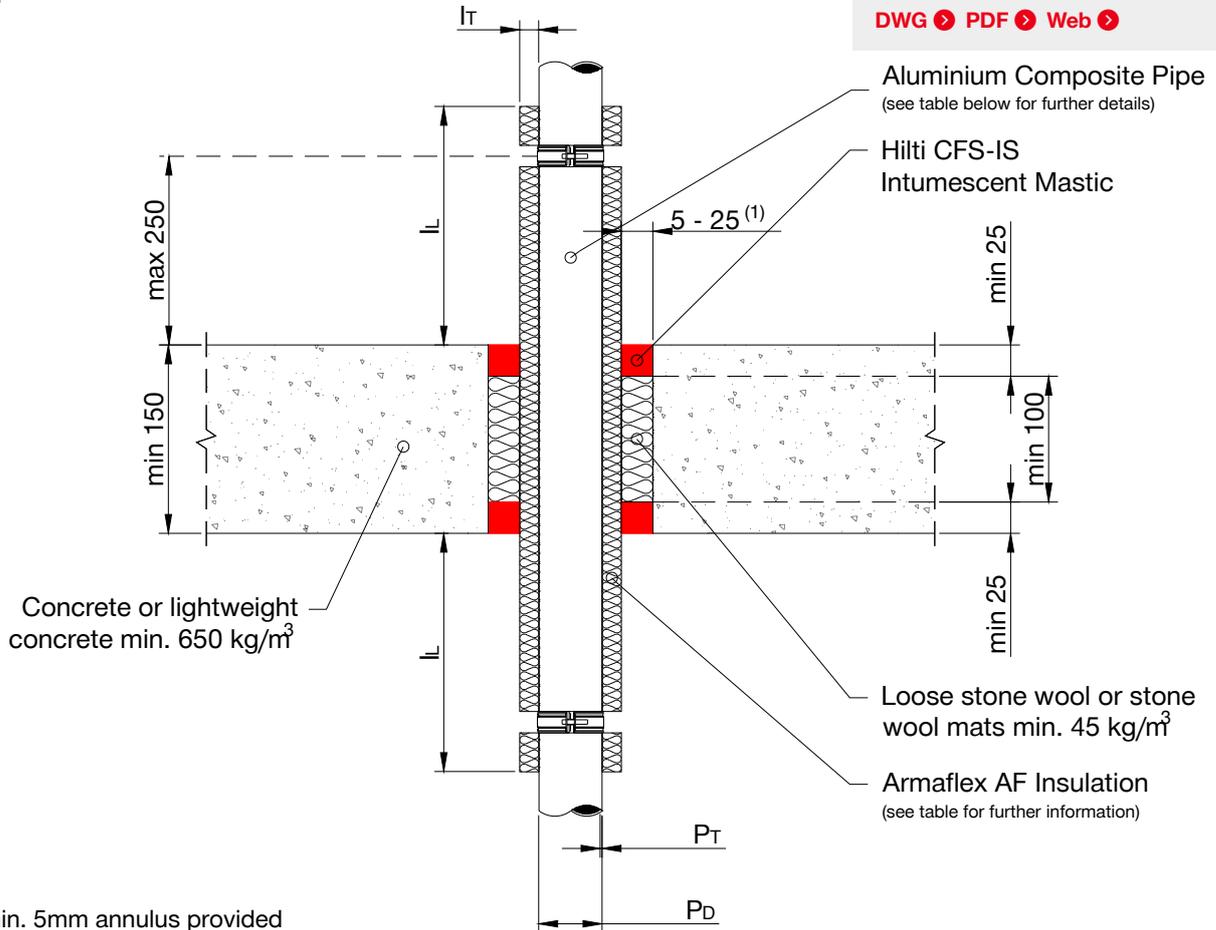

(1) min. 5mm annulus provided
min. 25mm on the opposite side

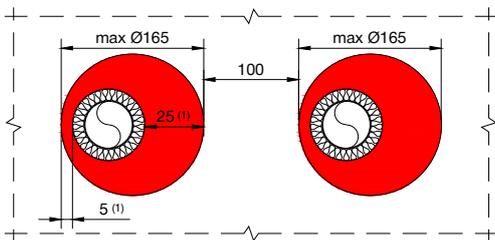

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm).

Min. 100mm distance to other firestopping penetrations and timber studs.

Min. 200mm to other penetrations (e.g., doors, windows etc.)

Pipe		Insulation		Classification
P _D Ø	P _T	I _T	I _L	
Geberit Mepla (PE-XD/Al/PE-HD) with Armaflex AF Insulation				
≥ 16-50	2.25-4.0	8-21	≥ 250	EI 120 U/C
Kelkelit Kelox (PE-XB/Al/PE-XB) with Armaflex AF Insulation				
≥ 16-50	2.0-4.0	8-21	≥ 250	EI 120 U/C
LK Schweden (PE-RT/Al/PE-RT) with Armaflex AF Insulation				
16-40	2.0-3.5	8-21	≥ 250	EI 120 U/C
Uponor Uni Pipe Plus (PE-RT/Al/PE-RT) with Armaflex AF Insulation				
≥ 16-32	2.0-3.5	8-19.5	≥ 250	EI 120 U/C
The above LS Insulation parameters are also valid for CS				

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

◀ Back

IS: SP-RF-M-02


ALUMINIUM COMPOSITE PIPES WITH NO INSULATION

Fire rating up to EI 120


Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG ▶ PDF ▶ Web ▶

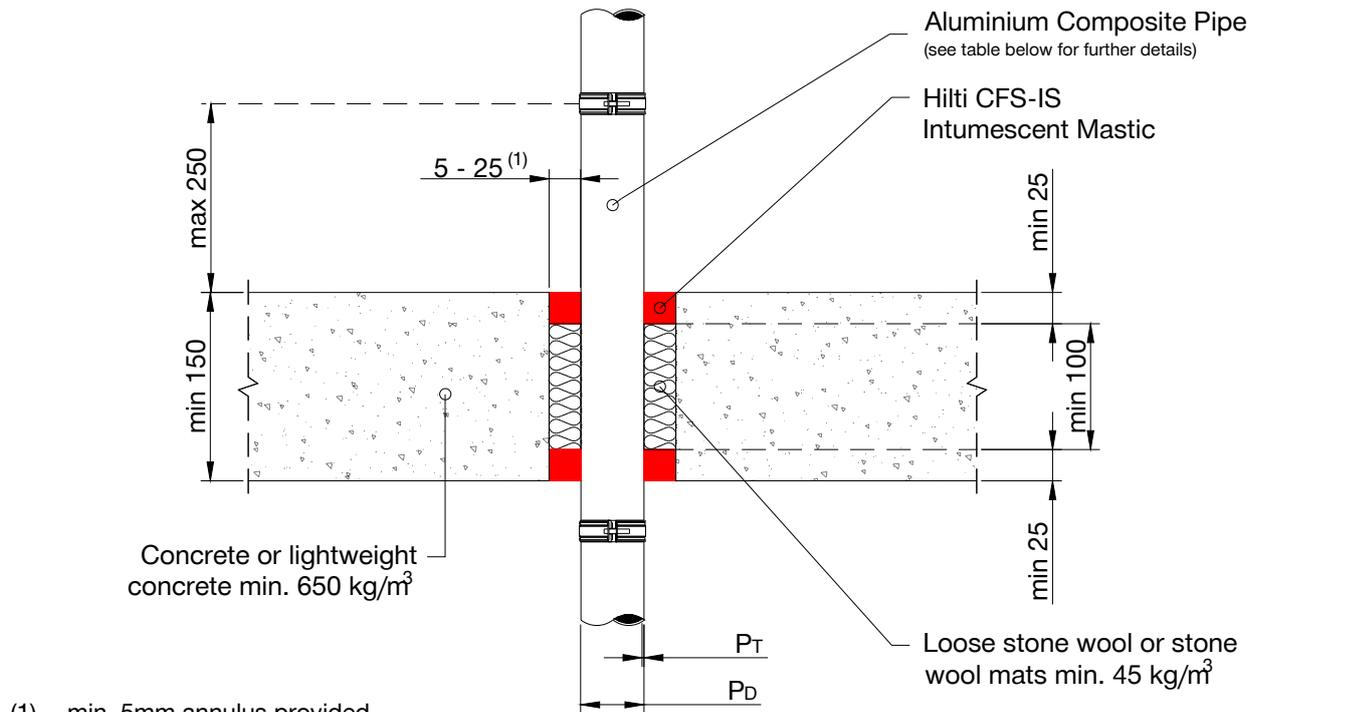

(1) min. 5mm annulus provided
min. 25mm on the opposite side

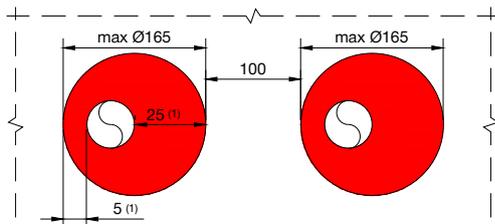

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm).

Min. 100mm distance to other firestopping penetrations and timber studs.

Min. 200mm to other penetrations (e.g., doors, windows etc.)

P _D Ø	Pipe	P _T	Classification
	Geberit Mepla (PE-XD/AL/PE-HD)		
≥ 16-50		2.25-4.0	EI 120 U/C
	Geberit Silent (PP-C/PP-MD/PP-C)		
≥ 32-50		2.0	EI 120 U/U
50		2.0	EI 120 U/C
	Kelkelit Kelox (PE-XB/AL/PE-XB)		
≥ 16-50		2.0-4.0	EI 120 U/C
	LK Schweden (PE-RT/AL/PE-RT)		
≥ 16-40		2.0-3.5	EI 120 U/C
	Uponor Uni Pipe Plus (PE-RT/AL/PE-RT)		
≥ 16-32		2.0-3.5	EI 120 U/C
	PP Life Master 3 (PP-CO/PP-MV/PP-CO-MV, EN1451-1)		
≥ 32-40		1.8	EI 90 U/U
50		1.8	EI 120 U/U

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

◀ Back

IS: SP-RF-M-03


PVC PIPES

Fire rating up to EI 120


Information

- Not to scale
- All units are in millimetres
- Tested according to EN 1366-3
- [Approval ETA-10/0406](#)

DWG ▶ PDF ▶ Web ▶

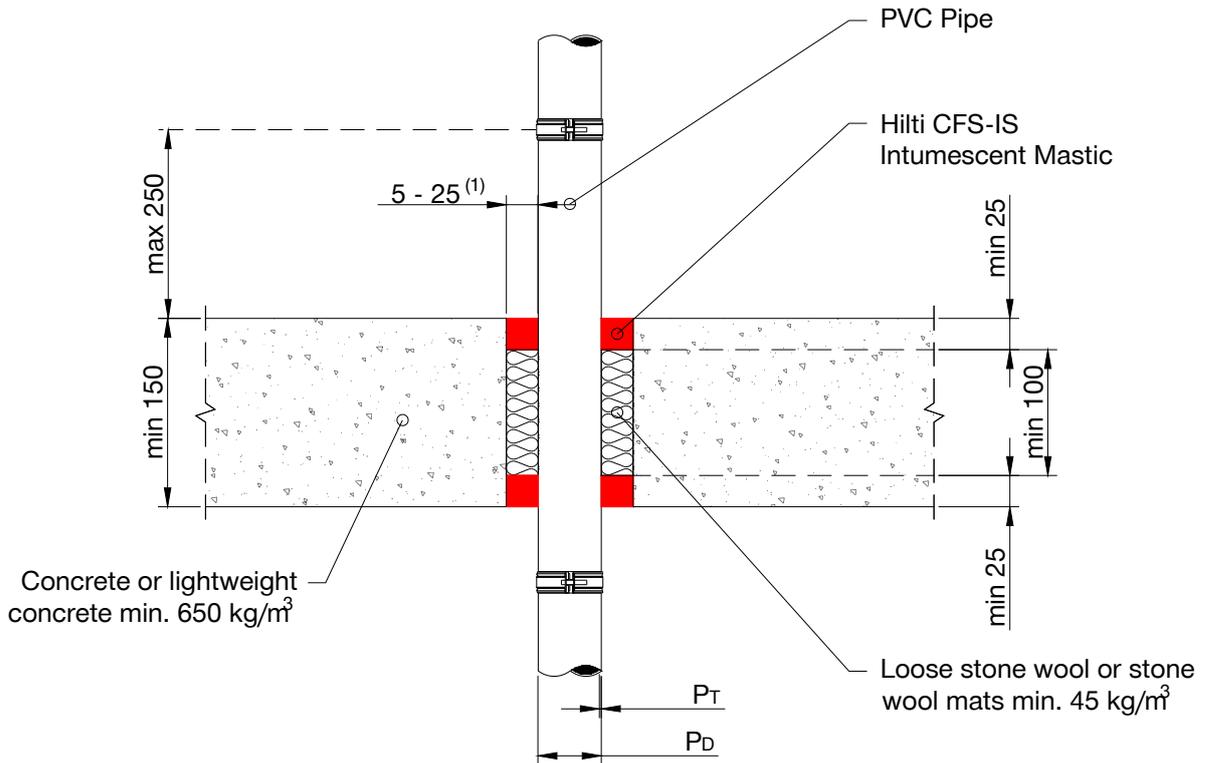

- (1) min. 5mm annulus provided
min. 25mm on the opposite side

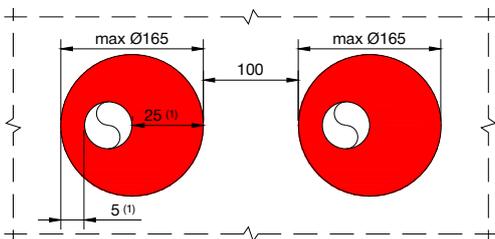

PVC pipes		
Conduit Type / Ø	Wall Thickness	Classification
≥ 16 – 20	1.8-2.3	EI 120 U/U
32	1.8-3.6	EI 60 U/U
≥ 34 – 40	2.0-3.0	EI 60 U/U
≥ 40 – 50	1.8-3.7	EI 120 U/C

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm).

Min. 100mm distance to other firestopping penetrations and timber studs.

Min. 200mm to other penetrations (e.g., doors, windows etc.)

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

IS: SP-RF-M-04


METAL PIPES WITH LOCALLY SUSTAINED INSULATION

Fire rating up to EI 120


Information

- Not to scale
- All units are in millimetres
- Tested according to EN 1366-3
- [Approval ETA-10/0406](#)

DWG ▶ PDF ▶ Web ▶

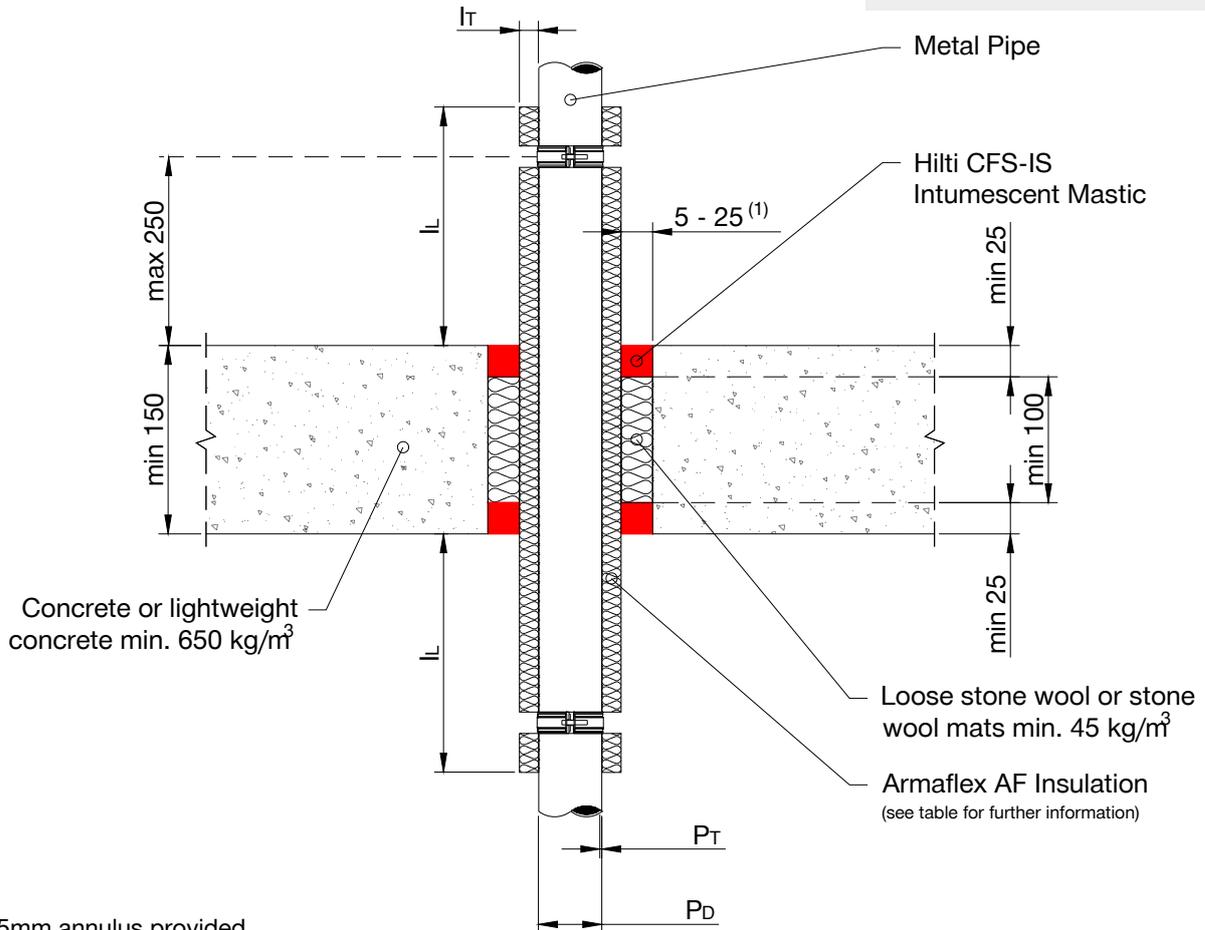

- (1) min. 5mm annulus provided
min. 25mm on the opposite side

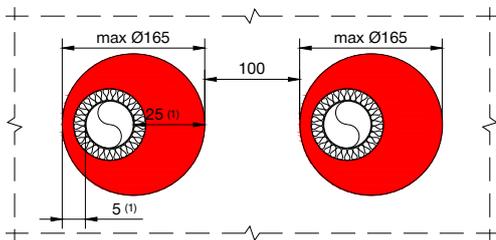

Pipe		Insulation		Classification
PoØ	Pt	Lt	Ll	
Copper/Steel Pipes (Locally Sustained) with Rockwool RS 800				
≥ 10-42	1.0 / 1.2-14.2	20	≥ 700	EI 120 C/U
≥ 42-89	1.0 / 1.2-14.2	40	≥ 925	EI 120 C/U

Max opening size 150mm x 150mm or circular openings of equivalent area (Ø 165mm).

Min. 100mm distance to other firestopping penetrations and timber studs.

Min. 200mm to other penetrations (e.g., doors, windows etc.)

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

IS: SP-RF-M-04


METAL PIPES WITH CONTINUOUS SUSTAINED INSULATION

Fire rating up to EI 120


Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

DWG ▶ PDF ▶ Web ▶

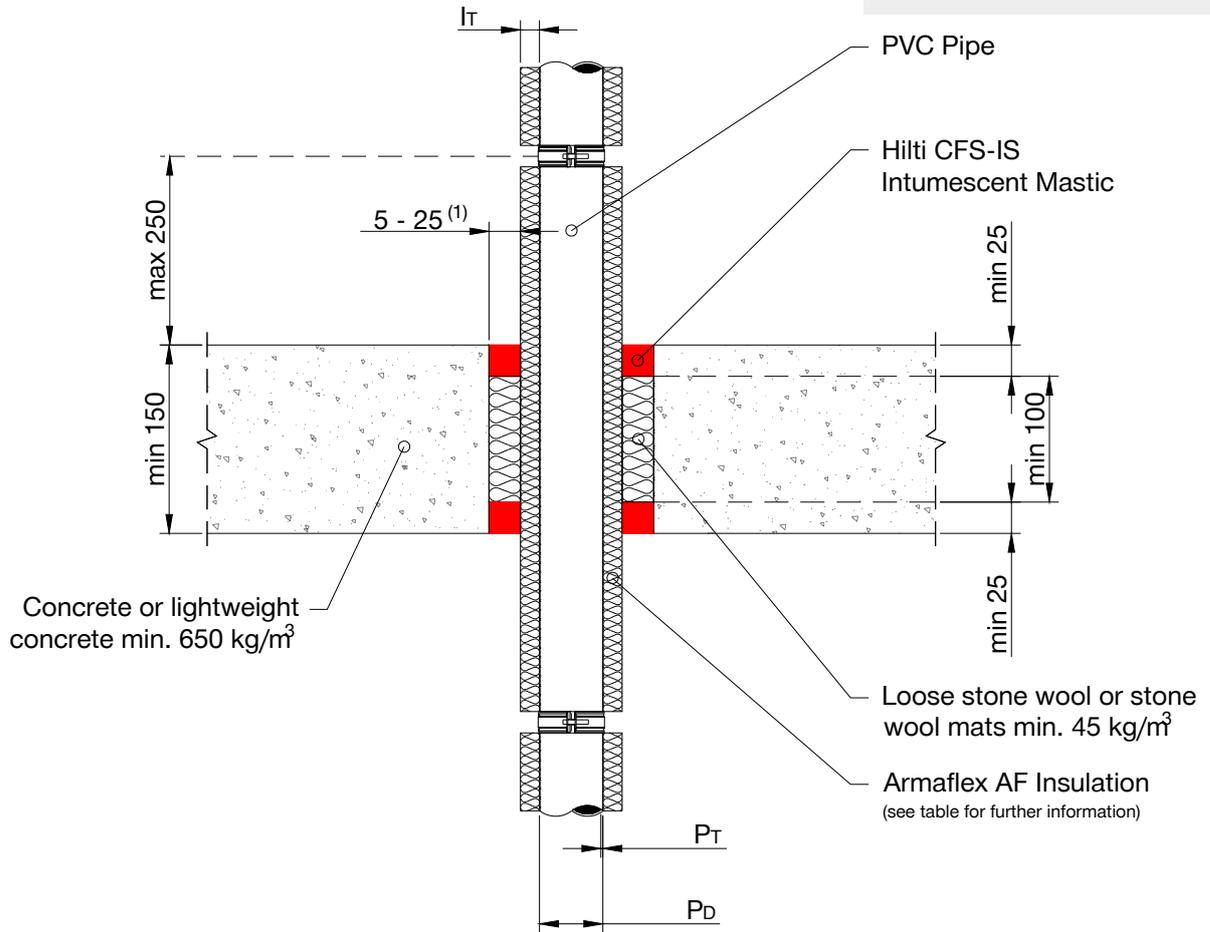

- (1) min. 5mm annulus provided
min. 25mm on the opposite side

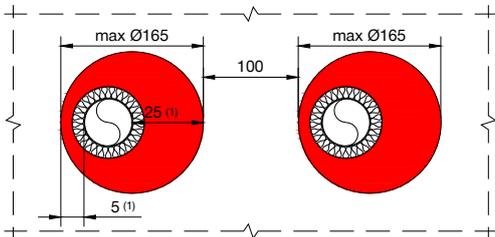

Pipe	Insulation	Classification
$P_D \varnothing$	I_T	
Copper/Steel Pipes (Continuously Sustained) with Armaflex AF		
$\geq 10-42$	1.0 / 1.2-14.2	EI 120 C/U
$\geq 42-89$	1.0 / 1.2-14.2	EI 60 C/U

Max opening size 150mm x 150mm or circular openings of equivalent area (\varnothing 165mm).

Min. 100mm distance to other firestopping penetrations and timber studs.

Min. 200mm to other penetrations (e.g., doors, windows etc.)

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
4. All services are to be correctly and adequately supported to prevent collapse and distortion.

◀ Back

IS: FW/RW-M-05


METAL PIPES WITH COMBUSTIBLE INSULATION IN FLEXIBLE WALL TH. ≥ 75 MM

Fire rating up to EI 60 C/U

Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- Classification report FIRES-CR-259-25-AUPE

DWG ▶ PDF ▶ Web ▶

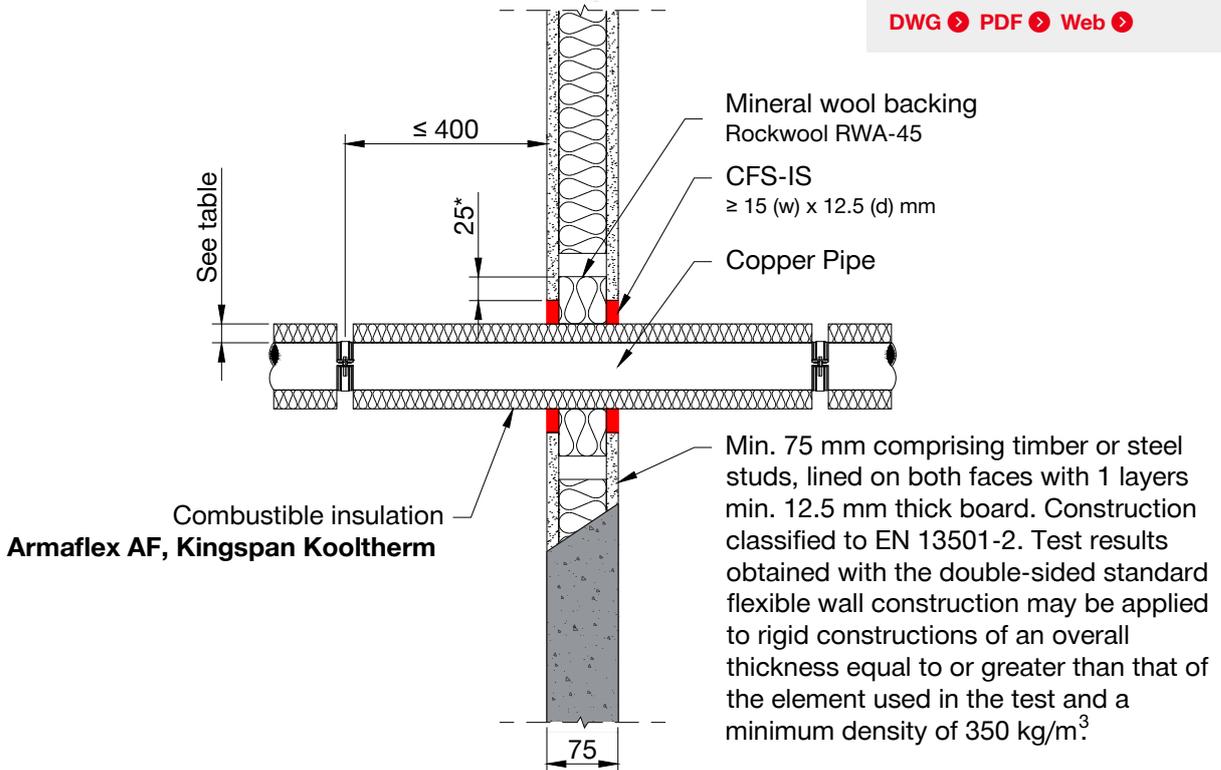

Notes:

- (*) The stone wool backing is applied to full depth inside the wall, overlapping the opening by 25 mm, type Rockwool RWA-45
- All services are passing through the penetration seals, perpendicular to the supporting construction.
- Distances between service openings ≥ 100 mm
- Annular gap ≥ 15 mm
- Distance between Hilti CFS-IS seal edge ≥ 15 mm
- Maximum seal size (150 x 150) mm (width x height)
- **Maximum distance to 1st rigid support: ≤ 400 mm**

Brand and type	Pipe \varnothing	Pipe wall thickness	Continued sustained insulation thickness	Classification
Armocell UK, Armaflex AF-CO	$\varnothing \leq 12$	≥ 0.6	9 to 32	EI 60 C/U
Armocell UK, Armaflex AF-CO	$\varnothing \leq 54$	≥ 1.2	13 to 32	EI 60 C/U
Kingspan, Kooltherm	$\varnothing \leq 12$	≥ 0.6	20 to 40	EI 60 C/U
Kingspan, Kooltherm	$\varnothing \leq 54$	≥ 1.2	20 to 40	EI 45 C/U
Kingspan, Kooltherm	$\varnothing \leq 54$	≥ 1.2	20	EI 60 C/U

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

◀ Back

IS: FW/RW-M-07


METAL PIPES WITH COMBUSTIBLE INSULATION IN FLEXIBLE WALL TH. ≥ 75 MM

Fire rating up to EI 60 C/U

Information

- Not to scale
- All units are in millimetres
- Tested according to EN 1366-3
- Classification report FIRES-CR-259-25-AUPE

DWG ▶ PDF ▶ Web ▶

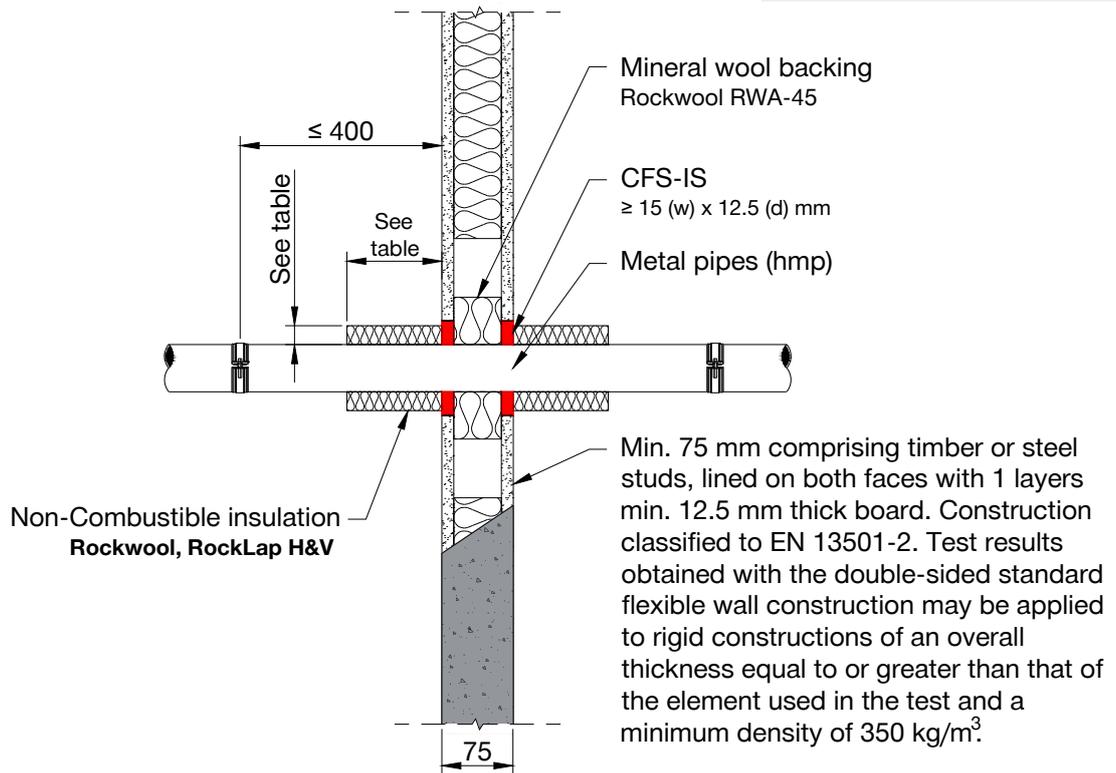

Notes:

- (*) The stone wool backing is applied to full depth inside the wall, overlapping the opening by 25 mm, type Rockwool RWA-45
- All services are passing through the penetration seals, perpendicular to the supporting construction.
- **Maximum distance to 1st rigid support: ≤ 400 mm**
- Maximum seal size (150 x 150) mm (width x height)
- Distances between service openings ≥ 100 mm
- Distances to the seal edge are ≥ 15 mm
- Annular gap ≥ 15 mm

Brand and type	Pipe \varnothing	Pipe wall thickness	Local interrupted insulation	Classification
Rockwool, RockLap H&V	$\varnothing \leq 54$	≥ 1.2	Thickness = 25 Length ≥ 350	EI 60 C/U
Rockwool, RockLap H&V	$\varnothing \leq 54$	≥ 1.2	Thickness = 25 Length ≥ 200	EI 45 C/U

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

◀ Back

IS: FW/RW-M-08


METAL CONDUITS IN FLEXIBLE WALL TH. ≥ 75 MM

Fire rating up to EI 30 C/U – E 60 C/U

Information

- Not to scale
- All units are in millimetres
- Tested according to EN 1366-3
- Classification report
FIRES-CR-259-25-AUPE

DWG ▶ PDF ▶ Web ▶

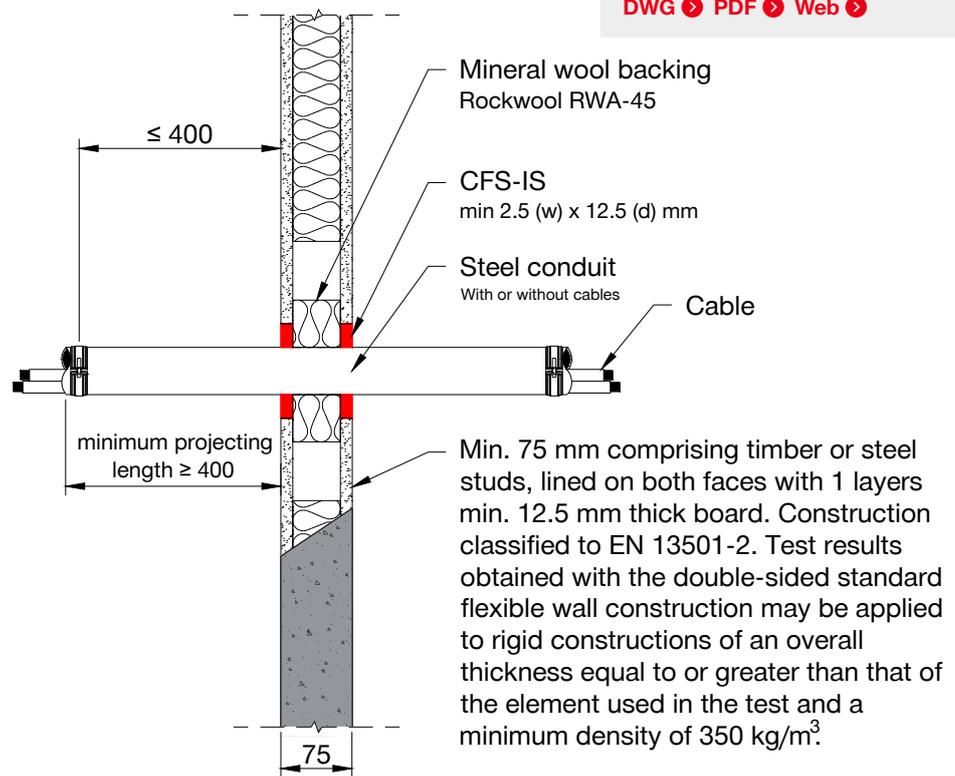

Notes:

- (*) The stone wool backing is applied to full depth inside the wall, overlapping the opening by 25 mm, type Rockwool RWA-45
- All services are passing through the penetration seals, perpendicular to the supporting construction.
- **Maximum distance to 1st rigid support: ≤ 400 mm**
- Maximum seal size (150 x 150) mm (width x height)
- Distances between service openings ≥ 100 mm
- Annular gap ≥ 2.5 mm

Service

Classification

I single rigid steel or stainless-steel conduits up to an outer diameter of 25 mm and wall thickness ≥ 1.6 mm including cables or empty.

Conduits of type “projecting” with a seal inside the conduits at one end in practice are covered, minimum projecting length ≥ 400 mm.

All sizes of cables currently and commonly used in building practice in Europe including optical fibre cables fitting into the conduit may be used in practice, subject to electrotechnical rules.

EI 30 C/U
E 60 C/U

Coaxial cables may be used up to a diameter fitting the conduit.

Non-sheathed cables (wires) are not covered.

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
4. All services are to be correctly and adequately supported to prevent collapse and distortion.

Hilti (Gt. Britain) Limited | No 1, Circle Square | 3 Symphony Park | Manchester | M1 7FS Freephone: 0800 886 100 | Website: www.hilti.co.uk

LEGAL NOTICE: This template contains Hilti Intellectual Property which is legally protected, including Community registration of Hilti trademarks. For use only by Hilti customers and in conjunction with Hilti products. No third party use/products is authorised and breaches Hilti's intellectual property rights. Hilti accepts no responsibility for unauthorized use and reserves all rights to take legal action to enforce its rights in law.

IS: FW/RW-E-06


CABLES IN FLEXIBLE WALL TH. ≥ 75 MM

Fire rating up to EI 30 – E 60

Information

- Not to scale
- All units are in millimetres
- Tested according to EN 1366-3
- Classification report
FIRES-CR-259-25-AUPE

DWG ▶ PDF ▶ Web ▶

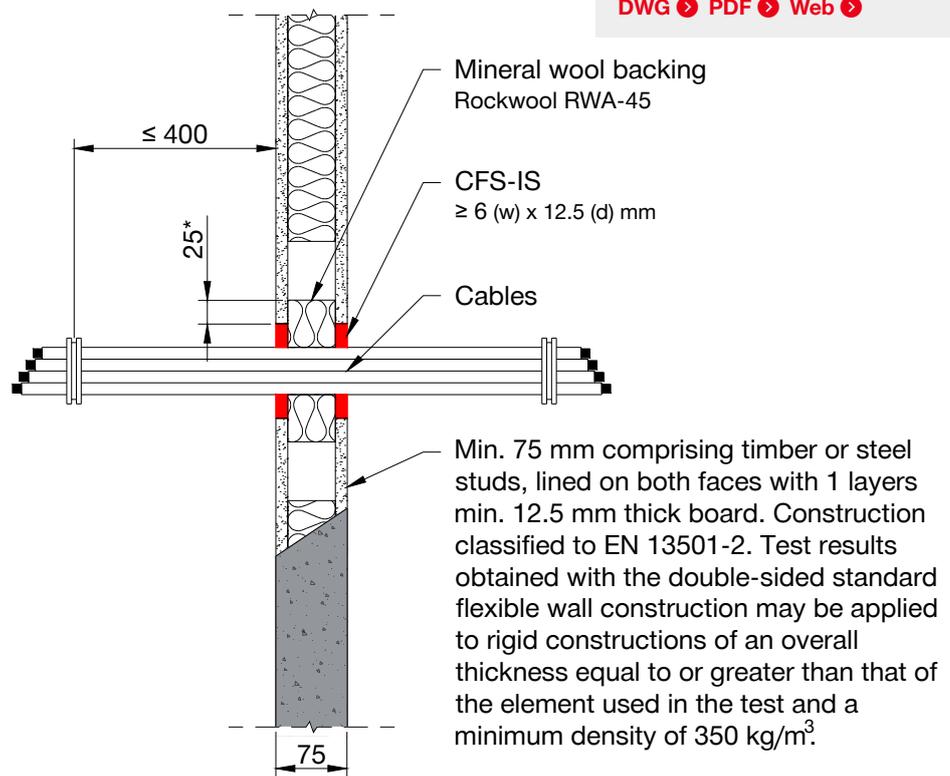

Notes:

- (*) The stone wool backing is applied to full depth inside the wall, overlapping the opening by 25 mm, type Rockwool RWA-45
- All services are passing through the penetration seals, perpendicular to the supporting construction.
- **Maximum distance to 1st rigid support: ≤ 400 mm**
- Maximum seal size (150 x 150) mm (width x height)
- Distances between service openings ≥ 100 mm
- Distances to the seal edge are ≥ 6 mm

Service	Working distances	Classification
All cable types currently and commonly used in building practice in Europe with a maximum outer diameter of 21 mm for coaxial cables and a maximum outer diameter of 21 mm for all other cables, subject to electro-technical rules.		
Non-sheathed cables (wires) and waveguides are not covered.		
Cables with a maximum diameter of 21 mm can be installed as a tied cable bundle, maximum bundle diameter 100 mm.	Separation to seal edge ≥ 6 mm	EI 30 E 60
Cable to cable distance ≥ 0 mm.		
Cable carriers cannot pass through the penetration seal.		

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

IS: FW/RW-E-06


CABLES IN FLEXIBLE WALL TH. ≥ 75 MM

Fire rating up to EI 60

Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- Classification report FIRES-CR-259-25-AUPE

DWG ▶ PDF ▶ Web ▶

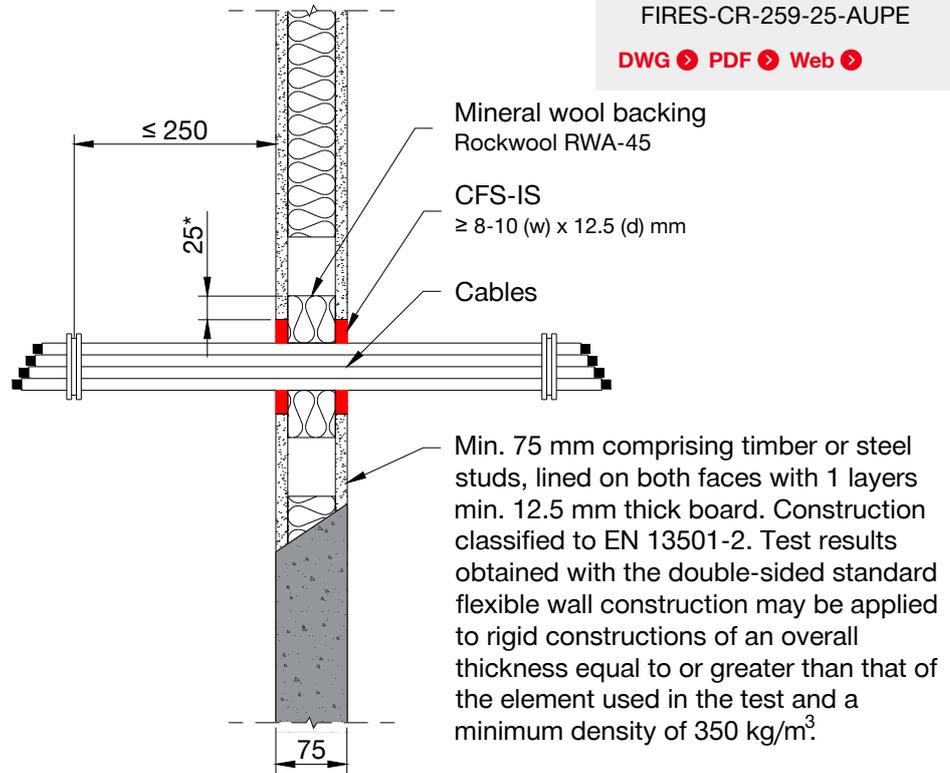

Notes:

- (*) The stone wool backing is applied to full depth inside the wall, overlapping the opening by 25 mm, type Rockwool RWA-45
- All services are passing through the penetration seals, perpendicular to the supporting construction.
- **Maximum distance to 1st rigid support: ≤ 250 mm**
- Maximum seal size (150 x 150) mm (width x height)
- Distances between service openings ≥ 100 mm
- Distances to the seal edge are ≥ 8/10 mm

Service	Working distances	Classification
<p>All cable types currently and commonly used in building practice in Europe with a maximum outer diameter of 21 mm for coaxial cables and a maximum outer diameter of 21 mm for all other cables, subject to electro-technical rules.</p> <p>Non-sheathed cables (wires) and waveguides are not covered.</p> <p>Cable to cable distance ≥ 0 mm.</p> <p>Cable carriers cannot pass through the penetration seal.</p>	<p>Separation to seal edge ≥ 10 mm</p>	<p>EI 60</p>
<p>Cables with a maximum diameter of 21 mm can be installed as a tied cable bundle, maximum bundle diameter 100 mm.</p> <p>Cable to cable distance ≥ 0 mm.</p> <p>Cable carriers cannot pass through the penetration seal.</p>	<p>Separation to seal edge ≥ 8 mm</p>	<p>EI 30 E 60</p>

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.

IS: FW/RW-E-06


CABLES IN FLEXIBLE WALL TH. ≥ 75 MM

Fire rating up to EI 60

Information

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- Classification report
FIRES-CR-259-25-AUPE

DWG ▶ PDF ▶ Web ▶

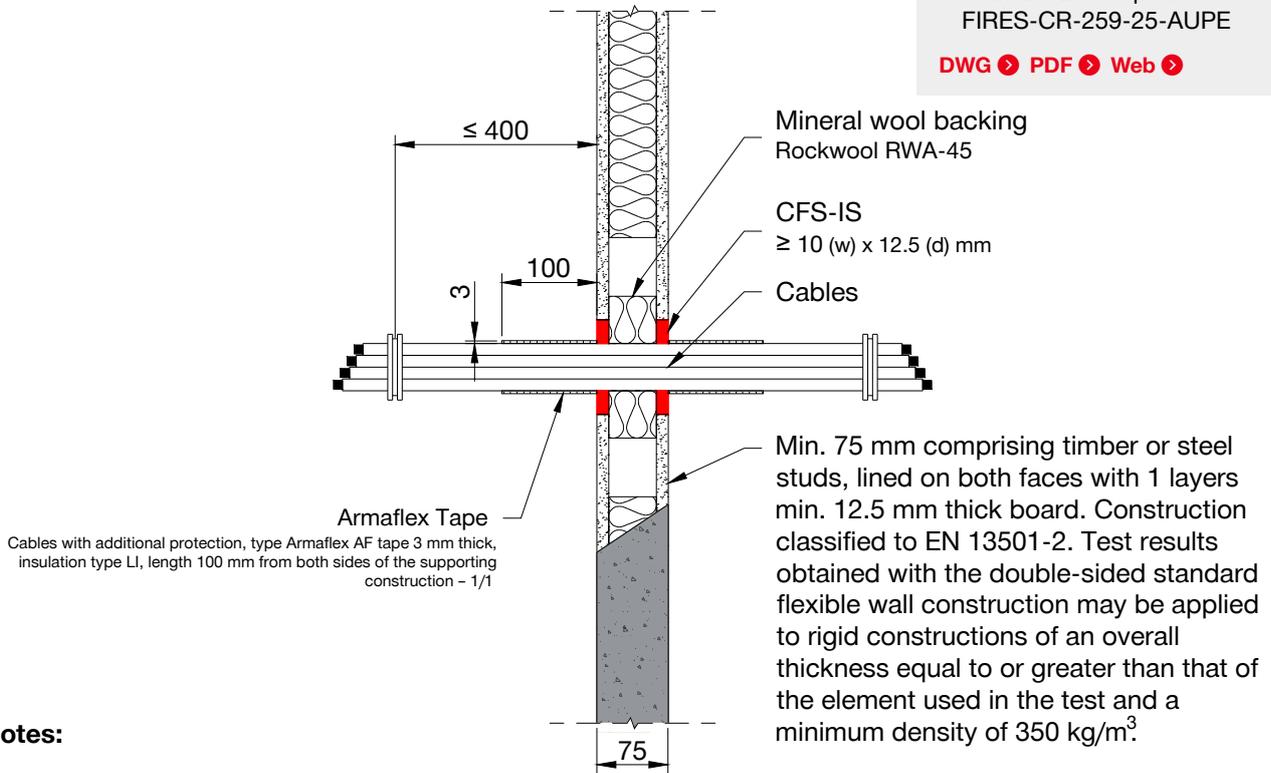

Notes:

- (*) The stone wool backing is applied to full depth inside the wall, overlapping the opening by 25 mm, type Rockwool RWA-45
- All services are passing through the penetration seals, perpendicular to the supporting construction.
- **Maximum distance to 1st rigid support: ≤ 400 mm**
- Maximum seal size (150 x 150) mm (width x height)
- Distances between service openings ≥ 100 mm
- Distances to the seal edge ≥ 10 mm

Service	Working distances	Classification
All cable types currently and commonly used in building practice in Europe with a maximum outer diameter of 50 mm for coaxial cables and a maximum outer diameter of 28 mm for all other cables, subject to electro-technical rules. Non-sheathed cables (wires) and waveguides are not covered. Cable to cable distance ≥ 0 mm. Cable carriers cannot pass through the penetration seal.	Separation to seal edge ≥ 10 mm	EI 30 E 60
All cable types currently and commonly used in building practice in Europe with a maximum outer diameter of 21 mm for coaxial cables and a maximum outer diameter of 21 mm for all other cables, subject to electro-technical rules. Non-sheathed cables (wires) and waveguides are not covered. Cables with a maximum diameter of 21 mm can be installed as a tied cable bundle, maximum bundle diameter 100 mm. Cable to cable distance ≥ 0 mm. Cable carriers cannot pass through the penetration seal.	Separation to seal edge ≥ 10 mm	EI 60

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.
2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.
3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.
4. All services are to be correctly and adequately supported to prevent collapse and distortion.

Single board drywall	Double board drywall	Rigid wall	Timber wall	Sandwich panel	Rigid floor	Timber floor	Metal deck	Linear joints			
Mechanical			Electrical			HVAC					
Min. base material thickness	Material	Pipes ¹	Size	N/C	Insulation ¹		Penetration type ¹			Classification ¹	Product/Detail ¹
					C	None	Single	Multi	Mixed		
≥ 75	Copper/Steel	Ø ≤ 54			CS		✓			≤ EI 60	CFS-IS:FW/RW-M-05
≥ 75	Copper/Steel	Ø ≤ 54		LS			✓			≤ EI 60	CFS-IS:FW/RW-M-07



Single board drywall	Double board drywall	Rigid wall	Timber wall	Sandwich panel	Rigid floor	Timber floor	Metal deck	Linear joints		
Mechanical			Electrical			HVAC				
Min. base material thickness	Cables	Tray	Electrical service			Penetration type ¹			Classification ¹	Product/Detail ¹
			Conduit	NC or C conduit	Trunking	Single	Multi	Mixed		
≥ 75	S = Ø ≤ 21					✓	✓		EI 30	CFS-IS:FW/RW-E-06
	B = Ø ≤ 100					✓	✓		EI 30	CFS-IS:FW/RW-E-06
≥ 75	S = Ø ≤ 21					✓	✓		EI 60	CFS-IS:FW/RW-E-06
	B = Ø ≤ 100					✓	✓		EI 30	CFS-IS:FW/RW-E-06
≥ 75	S = Ø ≤ 21					✓	✓		EI 60	CFS-IS:FW/RW-E-06
	B = Ø ≤ 100					✓	✓		EI 60	CFS-IS:FW/RW-E-06
	S = Ø ≤ 50					✓	✓		EI 30	CFS-IS:FW/RW-E-06
≥ 75			S = Ø ≤ 25			✓			EI 30 C/U	CFS-IS:FW/RW-M-08





Hilti (Gt. Britain) Ltd
No. 1 Circle Square
3 Symphony Park Manchester
M1 7FS

ask.hilti.co.uk
www.hilti.co.uk